
CHAPTER 8

8.000 RECLAIMED WATER

8.010 General

Any extension of the Lacey Class A Reclaimed Water System must be approved by the Department of Public Works (DPW). All extensions and uses must conform to the Water Reclamation and Reuse Standards published by the Department of Health (DOH) and the Department of Ecology (DOE) and City of Lacey ordinance 13.64 on Reclaimed Water Use.

In designing and planning for any development, the developer must show in the proposed plans how reclaimed water will be supplied and, as required by the City, whether adequate water pressure and volume will be available to meet the demand requirements. An analysis of the reclaimed water system may be required.

Anyone who wishes to extend or connect to the City's reclaimed water system shall contact the Department of Public Works for appropriate approvals and a connection fee estimate. This fee estimate is an estimate of the costs due the City for a reclaimed waterline extension or connection. A copy of the estimate form may be found in Appendix 'C'.

All construction plans shall be reviewed and approved by DOH, DOE and the City of Lacey prior to construction.

Prior to the release of any reclaimed water meters, all Public Works improvements must be completed and approved including granting of right-of-way or easements and Special Power of Attorney for Annexation if required, and all applicable fees must be paid.

Class A reclaimed water shall be discharged to the sanitary sewer system in order to remain in compliance with LOTT's State Reclaimed Water Permit. Where sanitary sewers are not accessible, dechlorinated Class A Reclaimed Water may be discharged to the stormwater system with approval from DOE. This includes any reclaimed water from blow-offs, line flushing and/or line breaks.

8.020 Design Standards

The design of any reclaimed water extension/connection shall conform to City Standards and any applicable standards as set forth herein and in Chapters 3.010 and 3.040.

Reclaimed Water mains shall be located in the center of the roadway, private drive or easement.

The layout of reclaimed water main extensions shall provide for the future continuation of the existing system. Reclaimed water mains shall be sized to provide adequate pressures throughout the system. Looping of the reclaimed water system may be required to provide adequate pressures and volume. Specific looping requirements shall be determined during plan review by the City. In addition, main extensions shall be extended as required in Chapter 3.130.

Where a reclaimed water system is installed for future use but supply is not yet available, the reclaimed main may be supplied from the potable water main through an approved Reduced Pressure Back Flow Assembly (RPBA) upon approval of the Director of Public Works. At such time that the reclaimed supply becomes available, it shall be the developer's or customer's responsibility to disconnect from the potable water supply and make the connection to the reclaimed water supply. There shall never be any physical connection between a reclaimed water main and a potable water main at the same time. The connection to reclaimed water and the abandonment of the connection to the potable water main shall be coordinated with and witnessed by the City.

All new reclaimed water piping and appurtenances shall be purple (Pantone 512) in color and have the words "RECLAIMED WATER-DO NOT DRINK" printed in black lettering at intervals no greater than 3 feet. Lettering shall be a minimum of 1.5 inches high. Spacing between the individual words of the message shall not exceed 3 inches.

Backflow shall be required on potable water service connections for all customers with reclaimed water service. The assembly type shall be a Reduced Pressure Backflow Assembly (RPBA). Reclaimed water irrigation systems using reclaimed water shall have a Double Check Valve Assembly (DCVA). See Chapter 6.110 for specific requirements.

The General Notes on the following page shall be included on any plans dealing with reclaimed water system design.


GENERAL NOTES (RECLAIMED WATER MAIN INSTALLATION)

1. Reclaimed water mains up to 12 inch shall be Pantone 512/522 AWWA C900 DR 14. Reclaimed water mains larger than 12 inches shall be Pantone 512/522 AWWA C905 DR 18. See Chapter 8.030B for more detailed pipe specifications.
2. Gate valves shall be resilient wedge, NRS (Non Rising Stem) with O-ring seals. Valve ends shall be mechanical joint or ANSI flanges. Valves shall conform to AWWA C-515 latest revision. Valves shall be Mueller, M & H, Kennedy, Clow R/W, Waterous Series 2500, EJ Flowmaster or American AVK. All valves shall be Pantone 512/522 in color.
3. All valves shall have a standard EJ or Olympic Foundry VB 950 water valve box set to grade with a 6 inch ASTM 3034 SDR 35 PVC riser from the valve to within six inches of the valve box top. The valve box and lid shall be per the detail at the end of this chapter.
4. **Existing valves shall be operated by City employees only.**
5. All lines shall be chlorinated and tested in conformance with the above referenced specification (Note 1) and Water Chapter 6.190 of *the Development Guidelines and Public Works Standards*.
6. The sterilization and flushing process for the reclaimed water main shall be the same as the potable water main. See chapter 6.200 for specific requirements. Bacteriological samples will not be required for reclaimed water mains.
7. All pipe and services shall be installed with continuous tracer tape installed 12" to 18" under the final ground surface. The marker shall be purple plastic non-biodegradable, metal core backing three inch wide marked "CAUTION RECLAIMED WATER LINE" which can be detected by a standard metal detector. In addition to tracer tape, install direct bury, U.S.E.12 gauge purple coated copper wire, wrapped around or taped to the pipe, as shown on the detail. Low voltage grease-type splice kits shall be used on tracer wire. Continuity testing of the wire will be done by the City.
8. All service line locations shall be marked on the top or face of the curb with an embossed "R" 3 inches high and 1/4 inch into concrete.
9. Separation between reclaimed water, sewer and the potable water mains shall be maintained per DOE, DOH and City of Lacey standards. See Development Guideline reclaimed water details for more specific requirements.
10. Commercial grade concrete shall be installed one foot around all valve boxes eight inches thick. A concrete pad per the reclaimed water detail shall be installed around all valve boxes and blow-offs that are not in a pavement area.
11. At any connection to an existing line where a new valve is not installed, the existing valve must be pressure tested to City standards prior to connection. If an existing valve fails to pass the test, the contractor shall make the necessary provisions to test the new line prior to connection to the existing system or install a new valve.

12. The minimum burial depth of all reclaimed water lines shall be 72 inches.
13. It shall be the contractor's responsibility to field verify the location and depth of the existing main and provide the fittings required to make the connection to the existing main.
14. When an existing City reclaimed water main is to be abandoned it shall be the developer's responsibility to coordinate and abandon the existing main. It shall also be the developer's responsibility to install and transfer existing reclaimed water services to the new main.
15. Sand or pea gravel shall be placed around and under service lines by hand to a height of 6 inches above and below the line (s). There shall be a minimum of 1 foot of sand placed around the entire meter box.
16. Meters 2 inches or larger in size must be ordered by the contractor/developer a minimum of 10 weeks in advance of install. Meters 3 inches or larger shall be installed by the contractor.
17. The reclaimed water main and appurtenances and service connections to the meter setter shall be tested in sections of convenient lengths under a hydrostatic pressure equal to 150 psi in excess of that under which it will operate. In no case shall the test pressure be less than 225 psi.
18. All new reclaimed water piping and appurtenances shall be purple (Pantone 512) in color and have the words "RECLAIMED WATER-DO NOT DRINK" printed in black lettering at intervals no greater than 3 feet. Lettering shall be a minimum of 1.5 inches high. Spacing between the individual words of the message shall not exceed 3 inches.
19. Class A reclaimed water shall be discharged to the sanitary sewer system in order to remain in compliance with LOTT's State Reclaimed Water Permit. This includes any reclaimed water from blow-offs, line flushing and/or line breaks.
20. To lower the risk of contamination, standard tapping practices used for potable water mains shall be followed when connecting to a reclaimed water main. See Water Chapter 6.040 Connection to Existing Water Main for specific requirements.

Revised: 03/2014

◆ PROCESS TO OBTAIN RECLAIMED WATER SERVICE

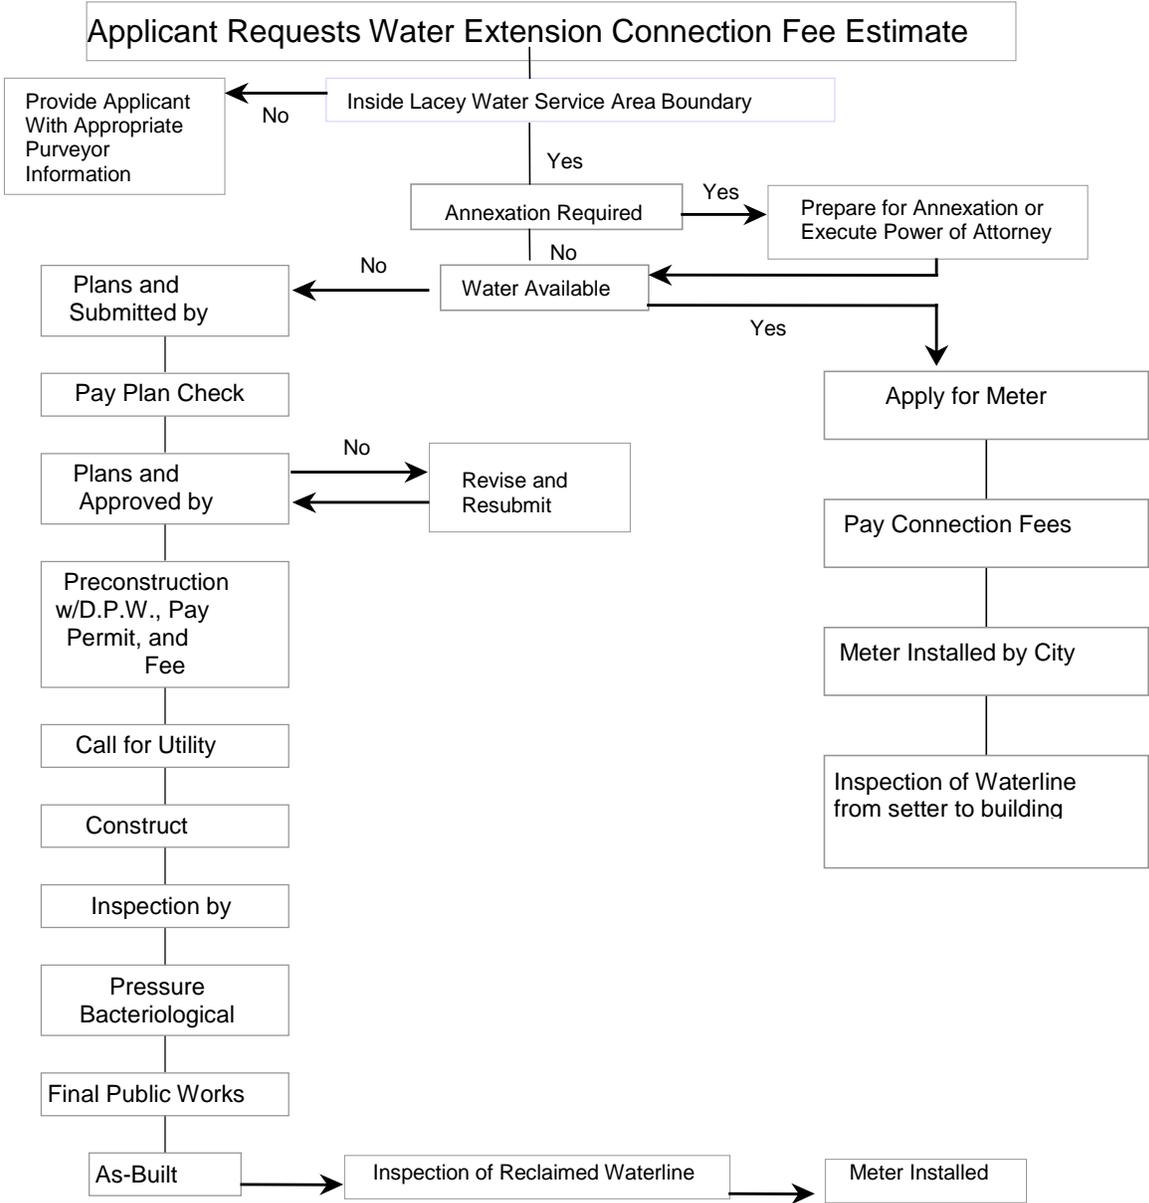

msspowerpoint/dgppp2.ppt
3/2007

8.030 Main Line

A. Reclaimed water mains shall be sized to provide adequate flow at the required residual pressure. The minimum main size shall be 6 inches diameter. Nothing shall preclude the City from requiring the installation of a larger sized main.

B. All pipe for reclaimed water mains shall comply with one of the following types:

All pipes joined using non-restrained joints shall be rubber gaskets, push on type or mechanical joint, conforming to AWWA C 111. When pipe joint restraints are required, the pipe shall be Certain Teed Certa-lok C900/RJ DR 14.

PVC Pipe: All piping shall be PVC with a minimum cover of 72 inches. The PVC pipe shall be purple (Pantone 512/522) in color and conform to the latest revision of AWWA C900 DR 14 standards.

C. All fittings shall be compact ductile iron fittings conforming to AWWA C 153. All shall be cement mortar lined conforming to AWWA C 104. Plain end fittings shall be ductile iron if mechanical joint retainer glands are installed on the plain ends. All fittings shall be connected by flanges or mechanical joints. All retaining follower glands shall be ductile iron.

D. All pipe and services shall be installed with continuous tracer tape installed 12 to 18 inches under the final ground surface. The marker shall be purple plastic non-biodegradable, metal core or backing which can be detected by a standard metal detector. In addition to tracer tape, install 12 gauge, solid, direct bury, U.S.E. purple coated copper wire, wrapped around or taped to the top of pipe, brought up and tied off at valve body as shown on the reclaimed water detail.

E. The minimum cover for all reclaimed water mains from top of pipe to finish grade shall be 72 inches unless otherwise approved. If the pipe is offset to the edge of the road, the actual roadway cross grade shall be projected out and used to measure cover to top of pipe. This will require more fill over the pipe in a fill section but allows the pipe adequate cover in the event of future roadway cuts or widening. If the pipe is located under a ditch, or on the "downhill" slope of the roadway cross section, the minimum cover over the pipe shall be 72 inches regardless of projected grades.

F. When minimum cover of the reclaimed water main is in conflict with other utilities, the engineer shall be required to provide the top and bottom elevations of the pipes in conflict. The adjustment of elevation when the minimum cover cannot be met shall be as directed by the city.

- G. When designing a reclaimed water main through an unimproved area the engineer shall provide a future design of the area to prevent design/construction of shallow mains. The design shall include elevations of the top of pipe at 25-foot intervals.

8.040 Connection To Existing Reclaimed Water Main

The developer's engineer shall be responsible for determining the scope of work for connection to existing reclaimed water mains. See reclaimed water details.

At the City's request the contractor shall install a temporary 2-inch brass blow off for flushing. The blow off shall be constructed with a standard 2-inch tapping saddle and Ford brass corporation stop with 2-inch brass pipe extended up to finished grade. When flushing is completed the 2-inch pipe shall be removed. The corporation stop shall be shut off and capped tight with threaded brass plug.

It shall be the Contractor's responsibility to field verify the location and depth of the existing main and the fittings required to make the connections to the existing mains.

No connection shall be made to an existing main on a Friday without Public Works approval.

A City representative shall be present throughout the entire connection or tapping procedure.

8.050 Service Interruption

The contractor shall give the City a minimum of 72 hours notice of any planned connection to an existing pipeline. This includes all cut-ins, live taps and extensions. Notice is required so any disruptions to existing services can be scheduled. The City will notify customers involved or affected by the service interruption. The contractor shall make every effort to schedule main construction with a minimum interruption of reclaimed water service. In certain situations, the City may dictate scheduling of reclaimed water main shutdowns so as not to impose service interruptions during specific periods to existing customers. Interruptions to service of the reclaimed water system shall be treated as if it were potable water.

8.060 Valves

All valves and fittings shall be ductile iron with ANSI flanges or mechanical joint ends. **All existing valves shall be operated by City employees only.**

Valves shall be installed in the distribution system at sufficient intervals to facilitate system repair and maintenance, but in no case

shall there be less than one valve every 1000 feet. Generally, there shall be three valves on each tee and four valves on each cross. Valves installed with tees and crosses shall be flanged together. All valves shall open counter-clockwise. Specific requirements for valve spacing will be made at the plan review stage.

- A. Gate Valves see page 8-3 for requirements.
- B. Reclaimed water valves shall be affixed with warning tags. Tags shall be securely fastened with a zip tie to the tracer wire at the top of the valve box in a manner that ensures visibility. Reclaimed water valve tags shall be inert polyethylene plastic that is impervious to all known alkalis, acids, chemical reagents and solvents likely to be encountered in the soil. The tags shall be 3" x 5 ³/₄" minimum size. Tags shall be purple and shall have the words, "CAUTION: RECLAIMED WATER-DO NOT DRINK" printed in black lettering. The lettering shall be a minimum of ½ inch high.
- C. Valve Box: All valves shall have a standard EJ or Olympic Foundry VB-950 water valve box set to grade with a 6 inch ASTM 3034 SDR 35 PVC riser from valve to within 4 to 6 inches of valve box top. Commercial grade concrete shall be installed one foot around all valve boxes eight inches thick. If valves are not set in paved area, a concrete pad shall be set around each valve box at finished grade. In areas where valve box falls in road shoulder, the ditch and shoulder shall be graded before placing asphalt or concrete pad. See reclaimed water detail.
- D. Valve marker post: Valve marker posts shall be 4 inch x 4 inch reinforced concrete or schedule 40 steel posts 5 feet long stamped with "R" and distance to valve in white. Posts shall be painted with 1 base coat and 2 coats purple oil base enamel. The need for valve marker posts will be determined during plan review. See reclaimed water detail.

8.070 Bend Markers

Bend markers are required when water lines are located outside the right-of-way. When the direction of a main changes due to a bend, a bend marker is required. See reclaimed water details.

8.080 Casing

The casing shall be as follows: one quarter inch wall seamless steel casing pipe or ductile iron class 52. Casing spacers are required. A minimum of three sets of spacers are required per 20 feet of pipe. Spacers shall be as manufactured by UniFlange. Calpico Inc. or approved equal. No more than one inch of clearance is allowed

between the top of the spacers and the inside top of the casing pipe. Approval of products requires research and therefore may be time consuming.

The joints of the transmission pipe within the casing pipe shall be restrained with a restraint system approved by the City of Lacey. Restrained joints shall be required on the transmission line one pipe length past either end of the casing pipe. Additional restraints may be required by the City.

8.090 Air and Vacuum Release Valve

Air and vacuum release valves (ARV) shall be installed behind the sidewalk on the property line. For mains up to 12 inches diameter ARV's shall be as shown on reclaimed water detail. The engineer shall size the ARV for mains 14 inches diameter and larger.

ARV's must be installed in a manner that will not create a cross connection condition. Measures to prevent backflow, cross connections, and contamination of the City system.

The installation shall be set at the high point of the line when required. ARV's shall not be installed in areas subject to high ground water or flooding. Where possible, pipes are to be graded to prevent the need for an air release valve.

8.100 Blowoff Assembly

A blow off shall be required at the end of all dead end mains. The blowoff assembly shall be as shown on the details. The working pressure rating for blowoff assemblies shall be 200 psi.

8.110 Sample Stations

- A. A sample station shall be required on any reclaimed water main extension for testing. The requirement for the location of the sample station will be determined by the City during the plan review. Sample stations shall be located behind the walk, in an open space, or in a utility easement whenever possible and shall generally be centrally located in the project at a low point if possible. The Type 93-WM sample station shall be installed in a single domestic meter setter per the reclaimed water detail.

8.120 Service Connection

- A. Service connections on reclaimed water for new developments shall be installed as part of the mainline construction. After the system has been accepted by the City and public works approval has been given the owner may apply for a reclaimed water meter.

The City will install a reclaimed water meter after the application has been made, the work completed, accepted and all applicable fees have been paid.

- B. When reclaimed water is desired to serve a parcel fronting an existing main but not served by an existing setter, an application must be made to the City. Upon approval of the application and payment of all applicable fees, the applicant shall hire a contractor to tap the main and install the service in accordance with Chapter 8.040.

Domestic or reclaimed water irrigation meters 2 inch or larger in size must be ordered through the City by the contractor/developer 10 weeks in advance of the installation date.

When applicable, conduit or casing is required by Thurston County for services crossing perpendicular to the roadway centerline outside the City limits but within the City of Lacey reclaimed water service area. The applicant is responsible for this work. Contact Thurston County for the required right-of-way permit(s) and restoration requirements, if any. If Thurston County allows trenching, conduit shall still be required.

- C. Service lines shall be as specified herein. Service lines shall be a one piece purple (Pantone 512) polyethylene plastic pipe from the reclaimed water main to the setter. Service lines shall be as specified herein. No glued joints will be accepted. Service lines shall be installed perpendicular to and 22½° above horizontal of the main. Purple warning tracer tape and wire wrapped around the pipe shall be installed on all service lines. When connecting to an existing system where the roadway cannot be cut, a casing shall be required.

One and one-half to two inch diameter service lines shall be NSF Approved, PE3408 purple polyethylene pipe manufactured from virgin materials. Pipe shall meet the following specifications:

- ANSI/AWWA C901
- ASTM D1248, ASTM D 3350, ASTM D 2239, ASTM D 3035 and ASTM D 2737,
- Pressure Class 200, SIDR – 7 (Standard Inside Dimension Ration-Pressure Rated),
- Cell classification 345464C,

Pipe shall be manufactured by Interstate Plastics, Philips Driscopipe, Eagle Pacific, Superlon Plastics, U.S. Poly or approved equal.

Service saddles with stainless steel straps shall be as shown on the details or approved equal. All clamps shall have rubber gasket and iron pipe threaded outlets.

Corporation stops shall be as shown on the appropriate detail or approved equal with iron pipe threads conforming to AWWA C 800. Stainless steel inserts shall be used with pack joints and polyethylene pipe.

8.130 Marking Service Lines

The location of all service lines shall be marked on the face or top of the cement concrete curb with a "R" 3 inches in height and 1/4 inch into the concrete. When asphalt rolled curb is allowed, the water shall be marked with a tag secured with a "PK" nail one foot toward centerline from the gutter. The tag shall be a minimum 1-1/4 inch diameter, 0.050 inch thick aluminum disk stamped "R" or an unstamped purple plastic equivalent.

8.140 Water Main/Sanitary Sewer and Reclaimed Water Crossings

The Contractor shall maintain a minimum of 18 inches of vertical separation between sanitary sewers/reclaimed water and water mains. To accommodate crossings, the minimum cover for reclaimed water main of 72 inches may be reduced upon approval by the City to provide for as much vertical separation as possible. When a reduced depth is allowed, approved alternate backfill material may be required by the City. See 8.080 for casing specifications.

Reclaimed water shall only be installed under water lines and shall be above sewer lines. The vertical separation of 18 inches shall be at a minimum of 10 feet on either side of the crossing. The longest standard length of pipe shall be installed so that the joints will fall equidistant from any sewer or water crossing. In some cases where minimum separation cannot be maintained, it may be necessary to encase the reclaimed water pipe and/or the sewer or water service per City of Lacey standards.

8.200 Hydrostatic Tests

The reclaimed water main and appurtenances and service connections to the meter setter shall be tested in sections of convenient lengths under a hydrostatic pressure equal to 150 psi in excess of that under which it will operate. Prior to sterilization and flushing, the installation shall be subjected to a hydrostatic pressure of 225 psi for 15 minutes, and any leaks or imperfections developing under said pressure shall be remedied by the contractor. The main shall be tested between valves. Insofar as possible, no hydrostatic pressure shall be placed against the opposite side of the valve being tested. Test pressure shall be maintained while the entire installation is inspected.

The contractor shall provide all necessary equipment and shall perform all work connected with the tests. The test pump shall be

clean and disinfected. Tests shall be made after all connections have been made and the roadway section is constructed to subgrade. This is to include any and all connections as shown on the plan. The contractor shall perform the test to assure that the equipment to be used for the test is adequate and in good operating condition and the air in the line has been released before requesting the City to witness the test.

8.205 Sterilization and Flushing

The sterilization and flushing process for the reclaimed water main shall be the same as the potable water main. See chapter 6.200 for specific requirements. When potable water is used to supplement the reclaimed water system, a bacteriological test shall be taken on the new main.

8.210 Reclaimed Water Irrigation

All reclaimed water irrigation systems located within the public right-of-way shall be designed by a State of Washington registered landscape architect or City approved design firm. Parts lists shall be submitted with each project.

Prior to submitting the design, the contractor/engineer/landscape architect shall hire an independent Certified Landscape Irrigation Auditor, as certified by The Irrigation Association, to review and approve the proposed design.

After the reclaimed water irrigation system is installed, the contractor shall provide an irrigation audit to be performed on the new system by an independent Certified Landscape Irrigation Auditor (CLIA), as certified by the Irrigation Association, prior to final field observation by the Engineer. The CLIA shall test for proper coverage as determined by the Landscape Irrigation Auditor Handbook, most recent edition. The CLIA shall provide written certification that the reclaimed water irrigation system installed provides proper coverage as provided in the handbook.

The General Notes on the following pages are required on all plans for City operated or maintained reclaimed water irrigation systems or on any owner association operated or maintained reclaimed water irrigation systems located within the public right-of-way.

At sewer lift stations, reclaimed water irrigation systems shall be installed with an approved backflow prevention assembly in accordance with Chapter 6.110 of this manual. See reclaimed water detail.

A separate reclaimed water irrigation meter shall be provided for reclaimed water irrigation systems. Medians shall require a separate meter. The reclaimed water irrigation system shall be installed after the area has been properly prepared. See Chapter 4B.125 for soil preparation requirements. The pipe trenches shall be no wider than is necessary to lay

the pipe or install equipment.

The median system shall be a completely separate system with its own separate appurtenances.

Reclaimed water irrigation sprinklers shall be situated so as to not wet any public street or sidewalk. Spray heads shall not be used in planters less than 3 feet wide. Drip reclaimed water irrigation methods shall be employed in areas less than 3 feet wide to prevent overspray. Turf heads shall be placed at finished grade as measured from the top of the sprinkler. Shrub heads shall be 12 inch pop up type placed at finished grade unless otherwise specified. Drip reclaimed water irrigation emitters shall be installed in accordance with the manufacturer's recommendations.

Installation and maintenance of reclaimed water irrigation systems in roadway planter strips shall be as shown in the table below. The system owner shall be responsible for the on-going utility expenses incurred.

	Single Family Residential Zones	Multi-Family & All Other Zones
Arterial Boulevard	Developer installs, Homeowners Association maintains or a Community Facilities District may be established per LMC 3.46	Developer installs. Owner or Owners Association maintains or a Community Facilities District may be established per LMC 3.46
Arterials	Developer installs, Homeowners Assn. maintains. If the association doesn't maintain, a Community Facilities District may be established at the City's discretion per LMC 3.46.	Developer installs. Owner or Owners Association maintains (the City will maintain where existing covenants don't address this issue)
Collectors	Developer installs, Homeowners Assn. maintains	Developer installs, Owners Association maintains
Residential	Developer installs & Homeowners Assn. maintains	Owner installs, owner maintains

GENERAL NOTES (RECLAIMED WATER IRRIGATION SYSTEMS)

1. It shall be the responsibility of the contractor to have a copy of an approved set of the landscaping plans signed by the Director of Public Works on the construction site at all times.
2. Electrical permits and inspections are required for all reclaimed water irrigation services within the City of Lacey. The contractor is responsible for obtaining permits prior to any type of actual construction. Prior to installation of any materials, the irrigation contractor shall submit for approval by the City, five copies of material catalog cuts, specifications, shop drawings and/or wiring diagrams. Any materials purchased or labor performed prior to such approval shall be at the contractor's own risk.
3. A clearly marked service disconnect shall be provided for every automatic reclaimed water irrigation installation unless otherwise stated on a City approved set of plans. The location and installation of the disconnect shall conform to the National Electrical Code (NEC) and City of Lacey standards. The service disconnect shall be City approved.
4. All low voltage wire shall be a minimum size of #14 UF from each control valve to the terminal interface.
5. All low voltage splices shall be Spears DS 400 or a City approved equal. All splices shall be done in valve control boxes. Direct burial splicing will not be allowed.
6. The automatic controller components shall be as specified in Chapter 8.210G of the Development Guidelines.
7. All materials specifications from Section G Material Specifications of this paragraph shall be shown on the plans.
8. A separate reclaimed water irrigation meter shall be provided for reclaimed water irrigation systems. Medians shall require a separate meter. The reclaimed water irrigation system shall be installed after the area has been properly prepared. See Chapter 4B.125 for soil preparation requirements. Pipe trenches shall be no wider than is necessary to lay the pipe or install equipment. The top 6 inches of topsoil shall be kept separate from the subsoil and shall be replaced as the top layer when backfill is made.
9. The median system shall be a completely separate system with its own separate appurtenances for City owned medians.
10. All reclaimed water irrigation lines to be installed under existing pavement or areas to be paved shall be installed within a casing. The casing shall be a minimum 4 inch diameter or twice the diameter of the encased pipe. The casing shall be AWWA C900 DR 14 PVC pipe. The reclaimed water irrigation casing shall extend a minimum of 1 foot beyond the structure under which casing is being jacked or bored.

11. Upon final acceptance of the work, the contractor shall submit two as-builts per Chapter 3.065.
12. Privately owned sprinkler heads built along slopes in excess of 2 percent shall contain check valves.

Revised: 03/2014

8.210 Reclaimed Water Irrigation (cont.)

A. Layout of Reclaimed water irrigation System

The contractor shall stake all reclaimed water irrigation heads and mark all proposed trenches within the reclaimed water irrigation system per the approved plans prior to installing the system. Alterations in layout may be expected, i.e., to conform to ground conditions and to obtain full and adequate coverage to the landscaping. However, no alterations shall be made without prior authorization by the City.

B. Excavation

All soil shall be prepared as specified in 4B.125 prior to trenching. Trenches shall be no wider at any point than is necessary to lay pipe or install equipment. Trench bottoms shall be of relatively smooth sand 4 inches below and 6 inches above the pipe.

Detectable marking tape shall be placed in the trench 6 inches directly above, parallel to, and along the entire length of all nonmetallic water line and nonmetallic conduit. The width and depth of the tape shall be as recommended by the manufacturer or the City.

C. Piping

The reclaimed water irrigation main line is the line containing the supply usually situated between the reclaimed water irrigation meter and the reclaimed water irrigation control valves. The reclaimed water irrigation lateral lines are the lines between the reclaimed water irrigation control valves and the connections to the reclaimed water irrigation heads. Swing joints, thick walled poly pipe, flexible risers, rigid pipe risers, and associated fittings are not considered part of the lateral line but incidental components of the reclaimed water irrigation heads.

All reclaimed water lines shall be purple PVC and be a minimum of 18 inches below finished grade as measured from the top of the pipe. Where possible, mains and laterals or section piping shall be placed in the same trench.

All reclaimed water irrigation lines to be installed under existing pavement or areas to be paved, shall be installed within a minimum 4 inch diameter or twice the diameter of the encased pipe. The casing shall be AWWA C900 DR 14 PVC pipe. The reclaimed water irrigation casing shall extend a minimum of 1 foot beyond the structure under which casing is being jacked or bored.

D. Valve boxes

Valve boxes shall be installed flush to grade outside of play and high vehicular and pedestrian traffic areas.

Valve boxes shall have filter fabric underlayment installed at the bottom to

prevent rodent intrusion and sediment builds up.

Valve boxes shall be supported with bricks or concrete blocks as approved by the City to prevent settlement.

Reclaimed water valve boxes shall be purple in color and have purple lids with permanent lettering stating: "reclaimed water do not drink".

E. Pipe Connections

During construction, pipe ends shall be plugged or capped to prevent entry of dirt, rocks, or other debris.

PVC pipe, couplings and fittings shall be handled and installed with care and in accordance with the manufacturer's recommendation. For gasketed connections, the outside of the PVC pipe shall be chamfered to a minimum of 1/16 inch at approximately 22 degrees. For all other connections, pipe and fittings shall be joined by solvent welding. Solvents used must penetrate the surface of both pipe and fittings which will result in complete fusion at the joint. The solvent and cement shall be of a type recommended by the pipe manufacturer.

Threaded PVC joints shall be assembled using Teflon tape as recommended by the pipe manufacturer.

On plastic to metal connections, work the metal connection first. Use a non-hardening compound on threaded connections. Connections between metal and plastic are to be threaded utilizing female threaded PVC adapters with a threaded schedule 80 PVC nipple only.

F. Electrical Wire Installation

The electrical controller shall be located in an open space or in a utility easement whenever possible.

All control wires shall be labeled at the controller, splice boxes and at the valves in the field.

Wiring between the automatic controller and the automatic valves shall be direct burial, #14 and may share a common neutral. A minimum of two spare # 14 UF yellow wires shall be installed from the controller to the furthest valve in each direction, looping through each control valve box. There shall be a 2 foot loop left in each control valve box. Separate control conductors shall be run from the automatic controller to each valve. When more than one automatic controller is required, a separate common neutral shall be provided for each controller and the automatic valve which it controls. Wire shall be installed adjacent to or beneath the reclaimed water irrigation pipe. Plastic tape or nylon ty-wraps shall be used to bundle wires together at 10 foot intervals, and the wire shall be "snaked" from side to side in the trench. When necessary to run wire separate from the reclaimed water irrigation pipe, the wire shall be bundled and placed under detectable marking tape. When lateral pipe lines have less than 18

inches of cover, direct burial wire shall be installed below the pipe at a minimum depth of 18 inches from finished grade.

Wiring placed under pavement and walls or through walls, shall be placed in reclaimed water irrigation casing. See 8.210 Section C.

Splices will be permitted only at junction boxes, valve boxes, or at control equipment. A minimum of 2 feet of excess conductor wire shall be left at all splices and terminal and control valves to facilitate inspection and future splicing.

G. Material Specifications

As a means of keeping the City's parts inventory to a minimum and maintenance personnel familiarized and knowledgeable about product operation, the following is a list of approved products to be used on all jobs in which the City will be responsible for maintenance and operations. Requests for approved equals need to be submitted to the City of Lacey Public Works Department, Development Review section.

Description	Approved Device
Pop Up Spray Heads	Rainbird 1800 PRS SAM <ul style="list-style-type: none"> • minimum of 6” pop up • installed on Toro Funny Pipe • must have a purple top
Gear Driven Rotary Heads	Hunter I-20 and I-40 Series <ul style="list-style-type: none"> • installed on prefabricated O-Ring PVC Swing Joints • check valves on all heads • must have a purple top
Remote Control Valve and Master Valve	Weathermatic 21000DW series installed with isolation ball valve and double union. A master valve shall be installed directly after the DCVA. The valves must be tagged “reclaimed water do not drink”
Quick Coupling Valves	West Ag 4V100-R-Y or Rainbird 44RC <ul style="list-style-type: none"> • installed at point of connection and at the furthest valve at the far end of the main line • installed on prefabricated O-Ring PVC Swing Joints • must have a purple lid
Double Check Backflow Preventer	Febco 850U or approved DOH equal with schedule 80 PVC unions. The double check backflow preventer shall be installed in a purple box.

Flow Sensing Device	<p>Data Industrial IR series</p> <ul style="list-style-type: none"> • installed with master control valve • wiring between flow sensor and reclaimed water irrigation controller shall be a twisted pair direct burial 2-conductor shielded 18 AWG or larger stranded copper wire with appropriate ratings for distance of run. Wire shall be a single run with no splices. • master control valve shall be the same valve as the remote control valve
Automatic Controller (for City owned and maintained systems)	<p>Toro Sentinel with stainless steel cabinet and full surge protection</p> <ul style="list-style-type: none"> • shall be grounded conforming to NEC specifications
Valve Boxes	<ul style="list-style-type: none"> • Carson 910-12B for Quick Coupler • Carson 1419B for remote control valve or larger • Other boxes shall be sized accordingly • 6 inch pit boxes will not be permitted • Valve boxes shall be purple in color
Shut-Off Valves	<p>Schedule 80 PVC True Union ball valve</p>
Drip Irrigation	<ul style="list-style-type: none"> • All drip lines shall be Netafim CV with all Netafim connectors • Use Netafim disk filter at each control valve • Note: no flush/vacuum valve are required

H. Flushing

All main supply lines shall receive two fully open flushings to remove debris that may have entered the line during construction. The first flushing shall be completed prior to installing valves or testing.

All lateral lines shall receive one full-open flushing prior to placement of sprinkler heads, emitters, and drain valves. Note, drain valves on main lines are not recommended. Quick couplers shall be installed on the down stream side at the cross connection device and at each terminus of the main line from the cross connection device. The flushing shall be of sufficient duration to remove any dirt and debris that have entered the lateral lines during construction.

I. Testing

All gauges used for testing water pressure shall be certified correct by an independent testing laboratory immediately prior to use on the project. Gauges shall be retested when ordered by the inspector.

Automatic controllers shall be tested by actual operation for a period of two weeks under normal operating conditions. Should adjustments be required, the Contractor shall do so according to the manufacturer's recommendation or under the City's direction until the operation is satisfactory to the City.

All main lines shall be purged of air and tested with a minimum static water pressure of 150 psi for 60 minutes without introduction of additional service or pumping pressure. Testing shall be done with one pressure gauge installed on the line in a location determined by the City inspector. Lines which show loss of pressure exceeding 5 psi after 60 minutes will be rejected.

All lateral lines shall be purged of air and tested in place at operating line pressure with a pressure gauge and with all fittings capped or plugged. The operating line pressure shall be maintained for 30 minutes with valves closed and without introduction of additional pressure. Lines which show leaks or loss of pressure exceeding 5 psi at the end of specified test period will be rejected.

The contractor shall correct rejected installations and retest for leaks as specified herein.

J. Backfill

Backfill shall not be started until all piping has been inspected, tested and approved by the City inspector, after which, backfilling shall be completed as soon as possible. All backfill material placed within 6 inches of the pipe shall be free of rocks, roots, or other objectionable material which might cut or otherwise damage the pipe.

Backfill from the bottom of the trench to approximately 6 inches above the pipe shall be by continuous compacting in a manner that will not damage pipe or wiring and shall proceed evenly on both sides of the pipe. The remainder of the backfill shall be thoroughly compacted, except that heavy equipment shall not be used within 18 inches of any pipe. The top 6 inches of the backfill shall be of topsoil material.

K. Adjusting System

Before final inspection, the contractor shall adjust and balance all sprinklers to provide adequate and uniform coverage. Spray patterns shall be balanced by adjusting individual sprinkler heads with the adjustment screws or replacing nozzles to produce a uniform pattern.

L. System Operation

The reclaimed water irrigation system shall be completely installed, tested and operable prior to planting unless otherwise specified in the plans or as approved by the City. The contractor shall be responsible for all maintenance, repair, and testing, inspecting and automatic operation of the system until all work is considered complete as determined by the final inspection.

M. As-Built Plans

Upon final acceptance of the work, the contractor shall submit two as-builts per Chapter 3.065.


LIST OF DRAWINGS

CHAPTER 8

RECLAIMED WATER

<u>Title</u>	<u>Drawing</u>
1" Reclaimed Water Meter Service	8-1
1-1/2" Reclaimed Water Meter Service W/bypass.....	8-1.5
2" Reclaimed Water Meter Service W/high Bypass.....	8-2
Standard Plumbing Configuration For 3" & 4" Meters.....	8-3
Double Check Valve Assembly For 2" or Smaller Irrigation	8-4.2
Double Check Valve Assembly for 3" & Up Irrigation.....	8-4.3
Irrigation Service For Commercial Sites Type II.....	8-4.7
Reclaimed Water Manhole Logo Cover & Frame Installation.....	8-6
Reclaimed Water Meter Installation.....	8-7
Fire Hydrant Assembly.....	8-8
2" Air And Vacuum Release Valve for Reclaimed Water.....	8-9
Blow-Off Hydrant Assembly in Planter Strip	8-10.1
2" Blowoff Assembly for Extendable Mains.....	8-10.2
Connection to Existing Main.....	8-11
Standard Valve Box Installation.....	8-12
Hydrant Bollard & Valve Marker Post Detail	8-13
Koraleen Sampling Station.....	8-17
#93-WM Sampling Station for Reclaimed Water.....	8-18
Reclaimed Water Pipe Encasement Requirements.....	8-23
Pipe Zone Bedding for Reclaimed Water Mains & Services.....	8-26

ENVIRONMENT	METER BOX
TO BE USED IN ALL APPLICATIONS	CHRISTY POLYMER BOX & LID BOX: FL 36T-12 LID: FL 36-D W/CITY OF LACEY STAMPED IN LID

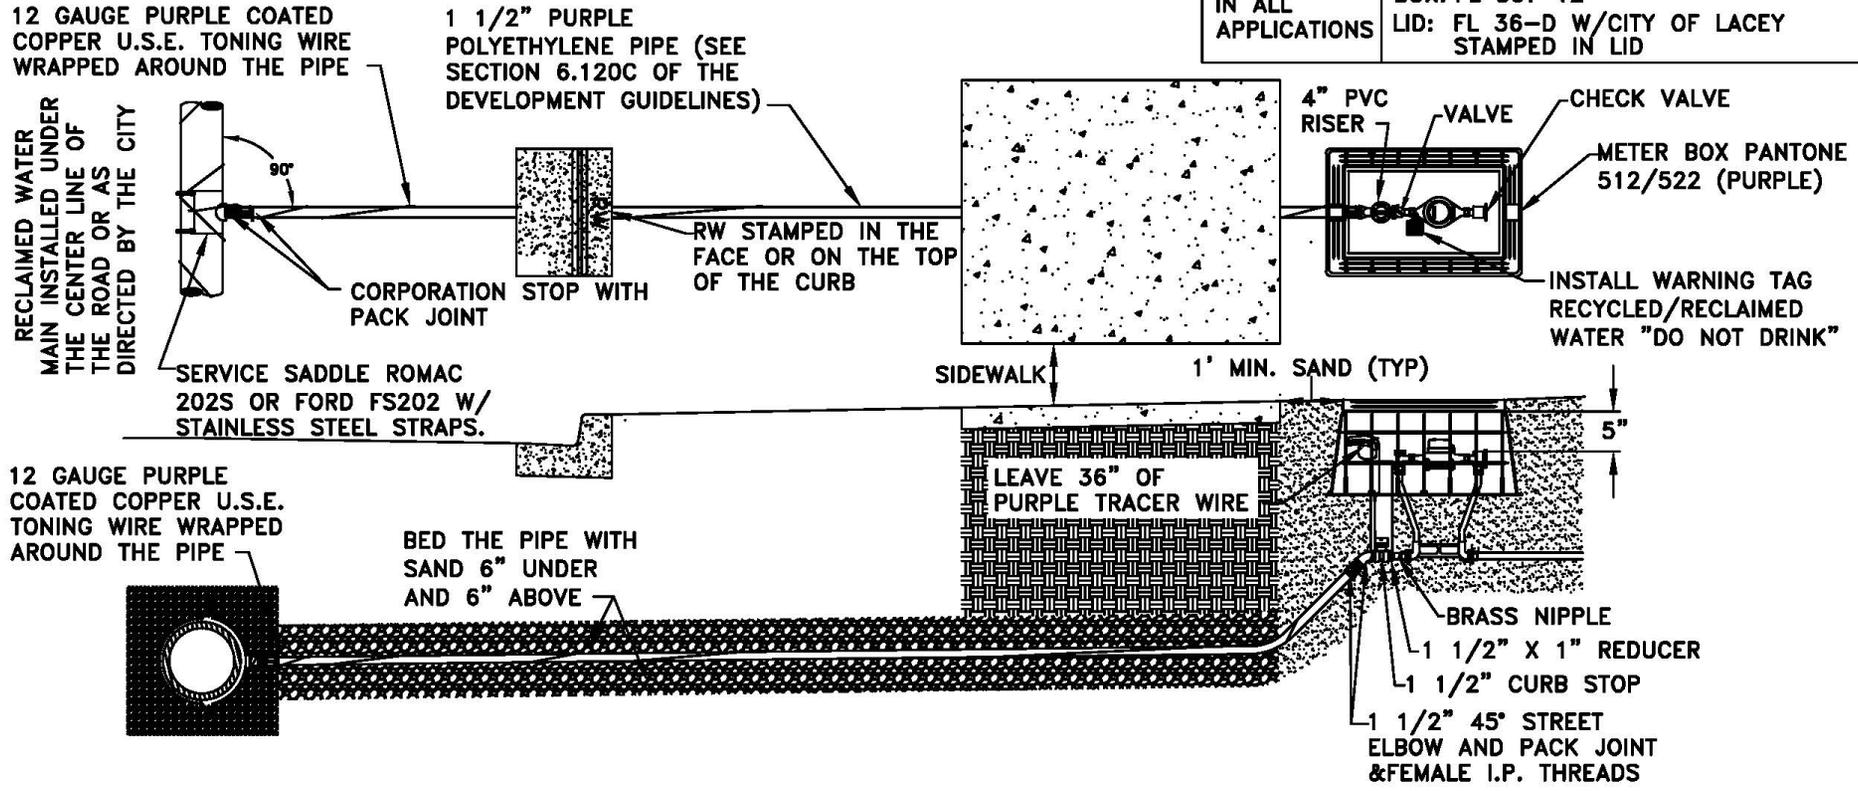

GENERAL NOTES:

1. METER BOXES SHALL NOT BE INSTALLED IN CONCRETE OR CONCRETE DRIVEWAYS. WHEN NECESSARY CREATE PLANTERS FOR METER BOX INSTALLATION.
2. STAINLESS STEEL INSERTS ARE REQUIRED FOR ALL PACK JOINTS.
3. THE SETTER ANGLE STOP SHALL BE A MINIMUM OF 1" ABOVE BOTTOM OF METER BOX. INSIDE OF BOX SHALL BE CLEAN OF EXCESS SAND OR DEBRIS.
4. FILL THE ENTIRE AREA AROUND AND UNDER THE METER BOX WITH A MINIMUM 1' OF SAND.
5. ALL BRASS AND COPPER SHALL BE LOW LEAD COMPLIANT.
6. COPPER METER SETTERS: FORD VBH 74-15W, MUELLER B2404-R2AG15, AY-McDONALD 20-412WCDD44.
7. BALL VALVE CURB STOP: FORD B11-66-NL, MUELLER B20283N, AY McDONALD 76101-1-1/2".
8. BALL VALVE CORPORATION STOP: FORD FB-1101-6G-NL, MUELLER E25029N, AY McDONALD 74704B-33-1 1/2".


CITY OF LACEY, WASHINGTON DEPT. OF PUBLIC WORKS			
1" RECLAIMED WATER METER SERVICE			
APPROVED <i>Ray A. Schaefer</i> CITY ENGINEER		DWG. NO. 8-1	
DES WHO	DWN WHO	CKD RAS	DATE 12/15/2014

METER SIZE	LINE SIZE	A	B	METER BOX IN PLANTER ONLY
1 1/2"	1 1/2"	13 1/4"	15"	CHRISTY FIBRELYTE BOX & LID BOX: FL 36T-18 LID: FL 36-D W/CITY OF LACEY IN LID

12 GAUGE PURPLE COATED COPPER U.S.E. TONING WIRE WRAPPED AROUND THE PIPE


1 1/2" PURPLE POLYETHYLENE PIPE (SEE SECTION 6.120C OF THE DEVELOPMENT GUIDELINES)

RECLAIMED WATER MAIN
INSTALLED UNDER THE
CENTER LINE OF THE
ROAD OR AS DIRECTED
BY THE CITY

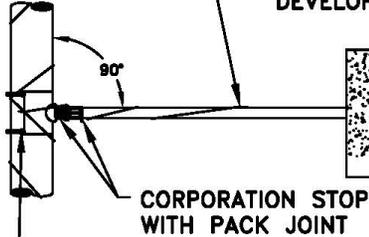

SERVICE SADDLE ROMAC 202S OR FORD FS202 W/ STAINLESS STEEL STRAPS.

RW STAMPED IN THE FACE OR ON THE TOP OF THE CURB

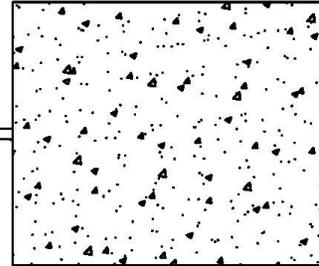

SIDEWALK

4" PVC RISER

VALVE


CHECK VALVE

METER BOX PANTONE 512/522 (PURPLE)

INSTALL WARNING TAG RECYCLED/RECLAIMED WATER "DO NOT DRINK"

12 GAUGE PURPLE COATED COPPER U.S.E. TONING WIRE WRAPPED AROUND THE PIPE

BED THE PIPE WITH SAND 6" UNDER AND 6" ABOVE



1' MIN. SAND (TYP)



LEAVE 36" OF PURPLE TRACER WIRE HIGH BY-PASS & VALVE WITH LOCKABLE CAP

METER REST BRACE ONLY

1 1/2" BRASS NIPPLE

1 1/2" CURB STOP

1 1/2" 45° STREET ELBOW AND PACK JOINT & FEMALE I.P. THREADS

GENERAL NOTES:

- METER BOXES SHALL NOT BE INSTALLED IN CONCRETE OR CONCRETE DRIVEWAYS. WHEN NECESSARY CREATE PLANTERS FOR METER BOX INSTALLATION.
- STAINLESS STEEL INSERTS ARE REQUIRED FOR ALL PACK JOINTS.
- THE SETTER ANGLE STOP SHALL BE A MINIMUM OF 1" ABOVE BOTTOM OF METER BOX. INSIDE OF BOX SHALL BE CLEAN OF EXCESS SAND OR DEBRIS.
- FILL THE ENTIRE AREA AROUND AND UNDER THE METER BOX WITH A MINIMUM 1' OF SAND.
- ALL BRASS AND COPPER SHALL BE LOW LEAD COMPLIANT.
- COPPER METER SETTERS, HIGH BY-PASS STYLE: FORD VBH 76-15HB, MUELLER B2423-29900015-15, AY-McDONALD 20-R615WDF665.
- BALL VALVE CURB STOP: FORD B11-666-NL, MUELLER B20283N, AY-McDONALD 76101-1-1/2".
- BALL VALVE CORPORATION STOP: FORD FB1101-6G-NL, MUELLER E25029N, AY-McDONALD: 74704B-33-1-1/2".

**CITY OF LACEY, WASHINGTON
DEPT. OF PUBLIC WORKS**

**1-1/2" RECLAIMED WATER
METER SERVICE W/BYPASS**

APPROVED

Bob A. Schaefer

CITY ENGINEER

DWG. NO.


8-1.5

DES
WHO

DWN
WHO

CKD
RAS

DATE
12/15/2014

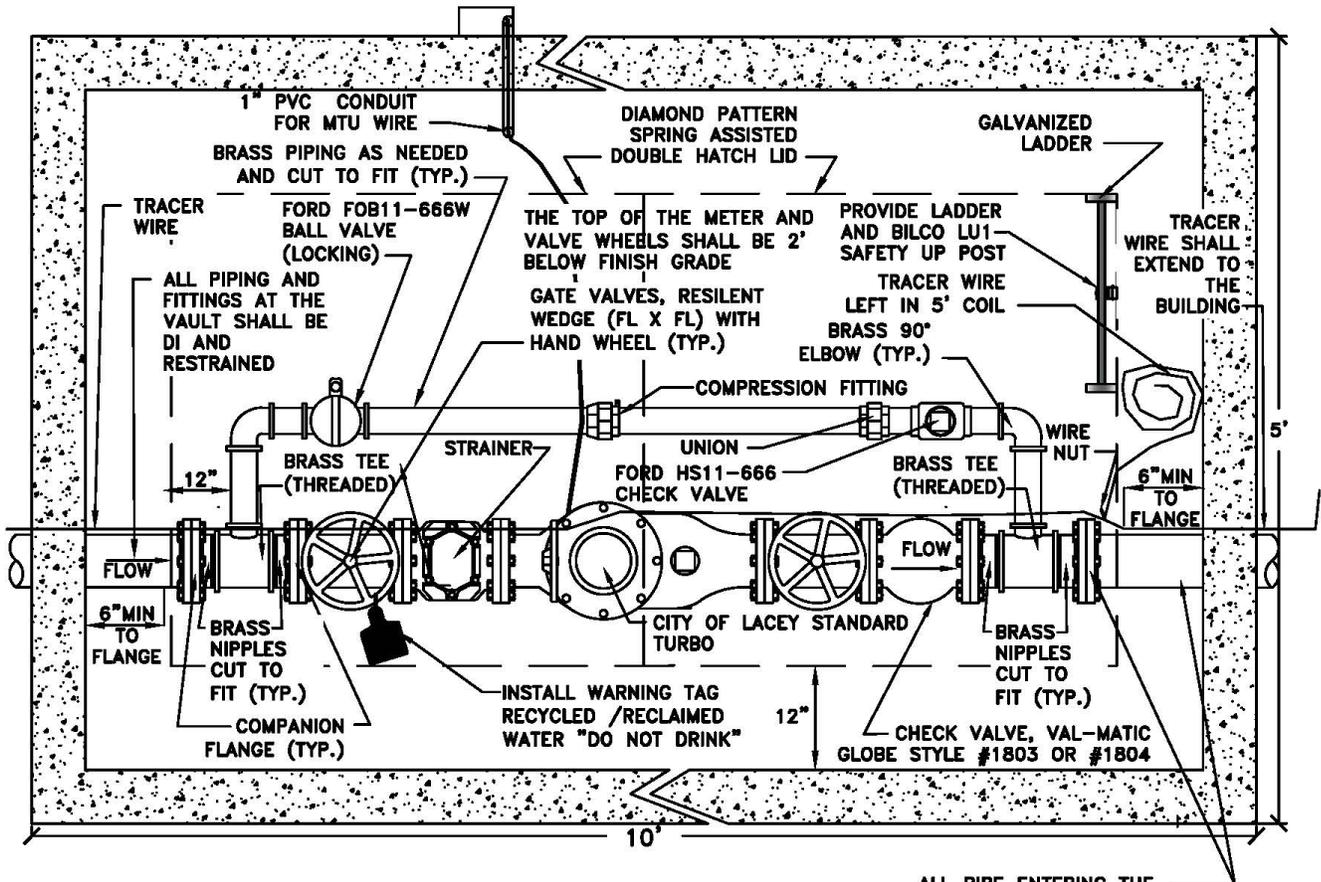

PLAN VIEW

GENERAL NOTES:

1. A MINIMUM OF 10 PIPE DIAMETERS OF STRAIGHT UNOBSTRUCTED PIPE SHALL BE REQUIRED UPSTREAM OF THE METER.
2. THE METER VAULT SHALL BE SIZED PROPERLY TO MEET MINIMUM PIPING CLEARANCE REQUIREMENTS.
3. THE CONCRETE METER VAULT SHALL BE BEDDED WITH 6" OF CRUSHED ROCK. THE INSTALLATION SHALL BE LEVEL AND SET TO MATCH FINAL GRADE.
4. THE CONCRETE METER VAULT AND LID SHALL BE DESIGNED FOR H-20 LOADING. THE HATCHES SHALL BE DIAMOND PLATE ALUMINUM STYLE, L.W. PRODUCTS, BILCO OR A PRE-APPROVED EQUAL AND SHALL HAVE ALL 316 STAINLESS STEEL HARDWARE. THE HATCHES SHALL HAVE A SLAM LOCK HASP AND WEATHER PROTECTED PAD LOCK COVER.
5. THE METER VAULT SHALL BE PROVIDED WITH A DRAIN AND THE FINAL INSTALLATION SHALL DRAIN PROPERLY.
6. THE BYPASS PIPING AND GLOBE STYLE CHECK VALVE ARE NOT REQUIRED FOR IRRIGATION ONLY INSTALLATIONS.
7. ALL PIPING SHALL BE A MINIMUM OF 12" ABOVE VAULT FLOOR AND BE SUPPORTED BY ADJUSTABLE JACK STANDS. THE STANDS SHALL BE PLACED IN FOUR LOCATIONS TO PROVIDE FIRM SUPPORT.
8. ALL BYPASS PIPE AND FITTINGS SHALL BE 2" DOMESTIC BRASS MEETING LOW LEAD REQUIREMENTS. GALVANIZED STEEL PIPING WILL NOT BE ACCEPTED.
9. THE TOP OF THE METER AND VALVE WHEELS SHALL BE MINIMUM 12" BELOW THE LID.
10. A HOLE SHALL BE DRILLED IN THE VAULT WALL 12" DOWN FROM THE LID FOR A 1" PVC ELECTRICAL CONDUIT TO A REMOTE READER BOX PLACED NO MORE THAN 3' AWAY FROM THE VAULT. THE REMOTE METER BOX SHALL BE A CHRISTY FL 30T. THE CONDUIT PENETRATION SHALL BE GROUTED.
11. THE VAULT SHALL BE INSTALLED IN A PLANTER OR IN A PLANTER ISLAND AND SHALL NOT BE ALLOWED IN ANY DRIVING SURFACE. WHEN PLANS ARE ALTERED A PLANTER ISLAND SHALL BE CREATED TO INSTALL THE VAULT IN.
12. IF A REDUCED PRESSURE BACK FLOW ASSEMBLY (RPBA) IS INSTALLED DOWN STREAM OF THE VAULT, A GLOBE STYLE CHECK VALVE WILL NOT BE REQUIRED. SUBSTITUTE A STANDARD DUCTILE IRON SPOOL PIECE IN ITS PLACE.



ALL PIPE ENTERING THE VAULT SHALL BE DUCTILE IRON PE AND THE CONNECTION SHALL BE MADE WITH A FIELD FLANGE

METER AND STRAINER LAY LENGTHS	
3" COMPOUND	17 "
3" TURBINE (IRRIGATION)	12 "
3" STRAINER	6 "
4" COMPOUND	20 "
4" TURBINE (IRRIGATION)	14 "
4" STRAINER	7.5 "

**CITY OF LACEY, WASHINGTON
DEPT. OF PUBLIC WORKS**

**STANDARD PLUMBING
CONFIGURATION FOR
3" & 4" METERS**

 CITY ENGINEER		DWG. NO. 8-3
DES WHO	DWN WHO	CKD RAS
DATE		12/15/2014

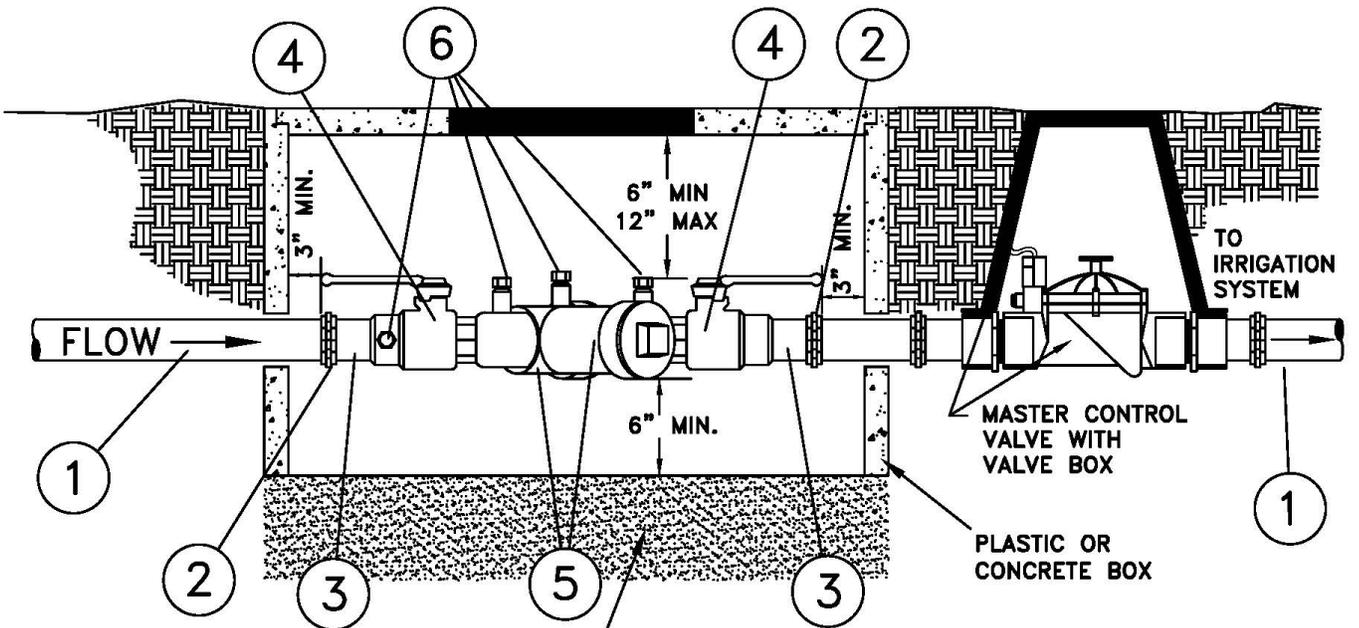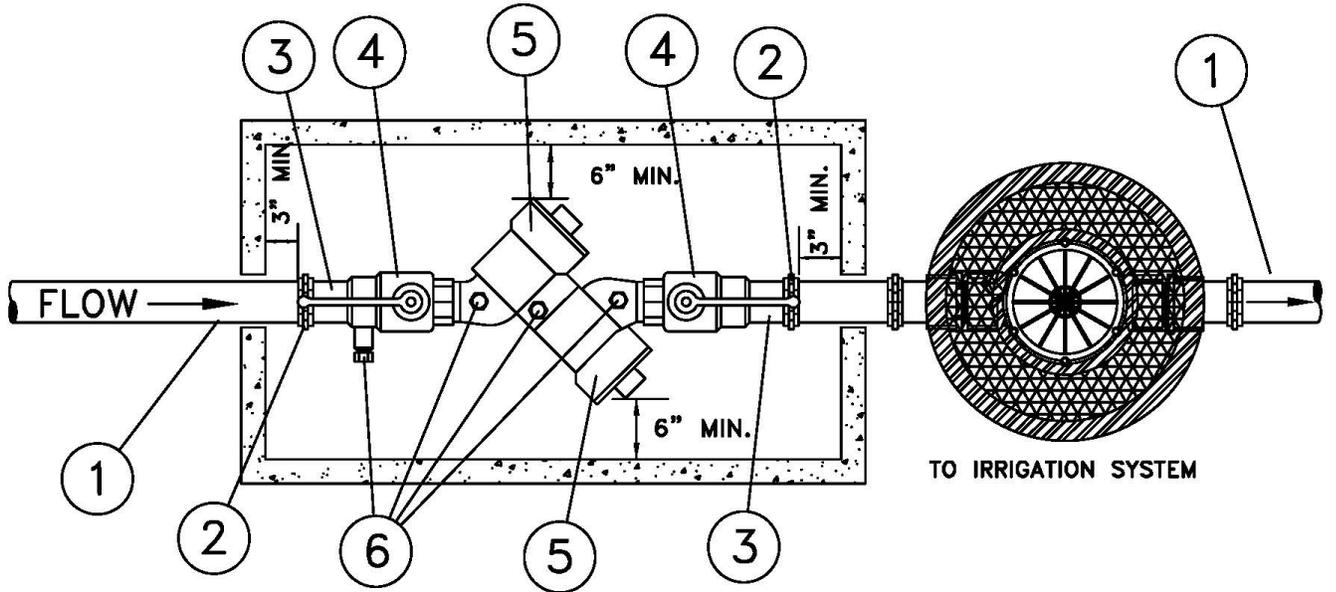

12" THICK PEA GRAVEL OR
1 1/2" MINUS WASHED ROCK

MATERIAL LIST:

1. SERVICE LINE
2. UNION
3. NIPPLE
4. SHUT-OFF VALVE
5. CHECK VALVE (D.S.H.S. APPROVED)
6. TESTS COCKS

GENERAL NOTES:

1. REFER TO THE CITY OF LACEY DEVELOPMENT GUIDELINES AND PUBLIC WORKS STANDARDS, SECTION 6.110, BACK-FLOW PREVENTION, FOR SELECTION AND INSTALLATION DETAILS.
2. THE BPA INSTALLATION SHALL BE INSPECTED AND APPROVED BY A CITY OF LACEY CROSS-CONNECTION CONTROL SPECIALIST (CCS), PRIOR TO TESTING.
3. WHEN THE INSTALLATION HAS BEEN APPROVED BY THE LACEY CCS, THE DCVA MUST PASS A FUNCTIONALITY TEST BY A WASHINGTON STATE CERTIFIED BAT AS PER DOH STANDARDS
4. SEE DETAIL 6-4.6 OR 6-4.7 FOR TYPICAL LAYOUT.
5. A MASTER CONTROL VALVE WITH UNIONS ON BOTH SIDES SHALL BE INSTALLED WITHIN 5' OF THE DCVA ON PUBLIC WORKS PROJECTS.
6. ALL PIPES, VALVE BOXES, VAULTS AND LIDS SHALL BE PURPLE (PANTONE 512/522) IN

DG8-4.201GR.

**CITY OF LACEY, WASHINGTON
DEPT. OF PUBLIC WORKS**

**DOUBLE CHECK VALVE
ASSEMBLY FOR 2"
OR SMALLER IRRIGATION**

APPROVED

Roger A. Schoenel
CITY ENGINEER

DWG. NO.

8-4.2

DES.

CM

DWN.



WHO

CKD.

RAS

DATE

12/15/2014

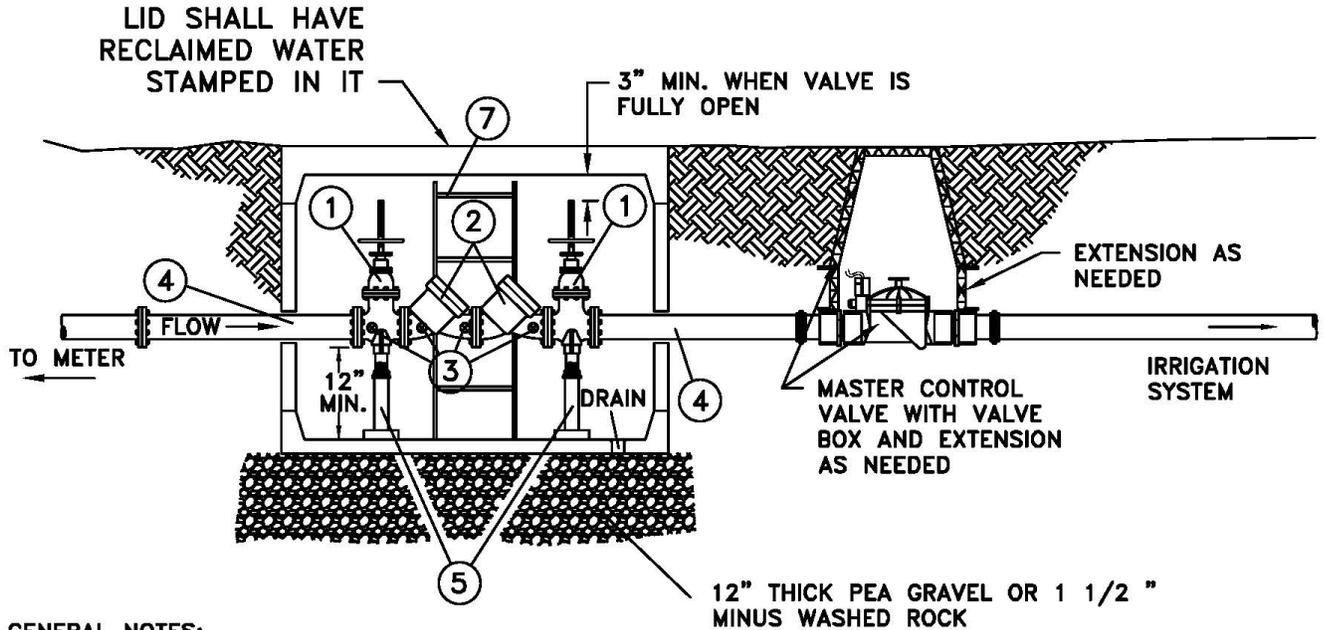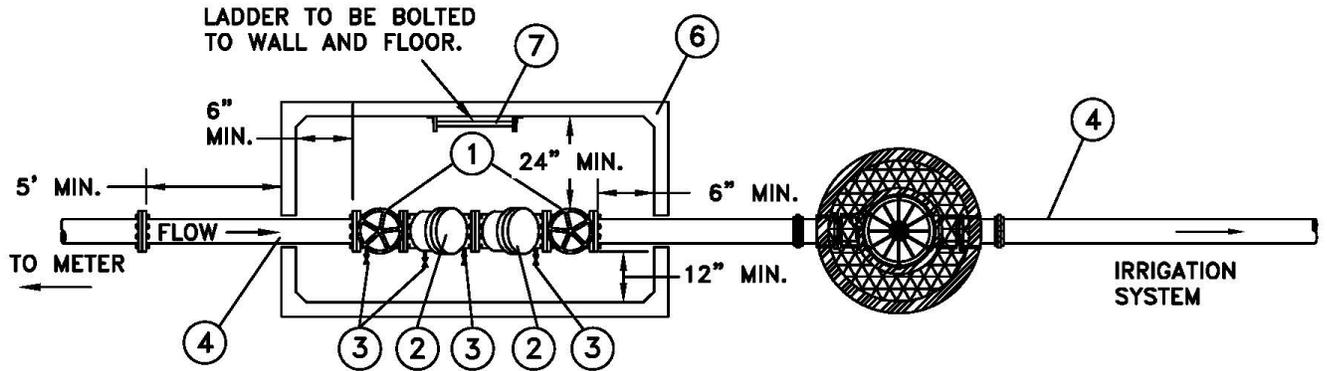

GENERAL NOTES:



1. REFER TO THE CITY OF LACEY DEVELOPMENT GUIDELINES AND PUBLIC WORKS STANDARDS, SECTION 6.110, BACKFLOW PREVENTION, FOR SELECTION AND INSTALLATION DETAILS.
2. THE BPA INSTALLATION SHALL BE INSPECTED AND APPROVED BY A CITY OF LACEY CROSS-CONNECTION CONTROL SPECIALIST (CCS), PRIOR TO TESTING.
3. WHEN THE INSTALLATION HAS BEEN APPROVED BY THE LACEY CCS, THE DCVA MUST PASS A FUNCTIONALITY TEST BY A WASHINGTON STATE CERTIFIED BAT AS PER DOH STANDARDS. DOCUMENTATION OF TESTING MUST BE SUBMITTED TO THE LACEY PUBLIC WORKS DEPARTMENT.
4. WHERE PIPING PASSES THROUGH CONCRETE WALL PROVIDE 2" CLEARANCE W/ WATERPROOF MASTIC OR FLEXIBLE SEALANT
5. ALL VAULTS MUST BE EQUIPPED WITH A DRAIN OR FLOAT ACTIVATED ELECTRIC PUMP.
6. ALL IRRIGATION LINES UP TO THE FIRST VALVE ON THE DCVA SHALL BE DISINFECTED, PRESSURE TESTED, FLUSHED AND TESTED FOR PURITY PER THE CITY OF LACEY STANDARDS.
7. A MASTER CONTROL VALVE WITH UNIONS ON BOTH SIDES SHALL BE INSTALLED WITHIN 5' OF THE DCVA ON PUBLIC WORKS PROJECTS.
8. ALL PIPES, VALVE BOXES, VAULTS AND LIDS SHALL BE PURPLE (PANTONE 512/522) IN

MATERIAL LIST:

1. OS&Y GATE VALVE W/HANDWHEEL FL X FL
2. DSHS APPROVED CHECK VALVE FL X FL
3. TEST COCK - 4 REQUIRED
4. PVC C900 OR CLASS 52 DI WALL PIPE FL X FL
5. VALVE STANDS
6. VAULT FOR 3" OR 4" DCV ASSEMBLIES—USE PIPE INC. VAULT NO. 448402 W/L.W. HATCH NO. HDSA 3' X 3' DOUBLE DOOR OR APPROVED EQUAL.
7. LADDER

CITY OF LACEY, WASHINGTON DEPT. OF PUBLIC WORKS			
DOUBLE CHECK VALVE ASSEMBLY FOR 3" & UP IRRIGATION			
APPROVED <i>Rog A Schoenel</i> CITY ENGINEER			DWG. NO. 8-4.3
DES. WHO	DWN. WHO	CKD. RAS	DATE





LINE SIZE	BALL VALVE	VALVE BOX
3/4"	FORD FOB11-333W	CARSON MODEL 910-12
1"	FORD FOB11-444W	
1 1/2"	FORD FOB11-666W	
2"	FORD FOB11-777W	
2 1/2"	FORD FOB11-788W	

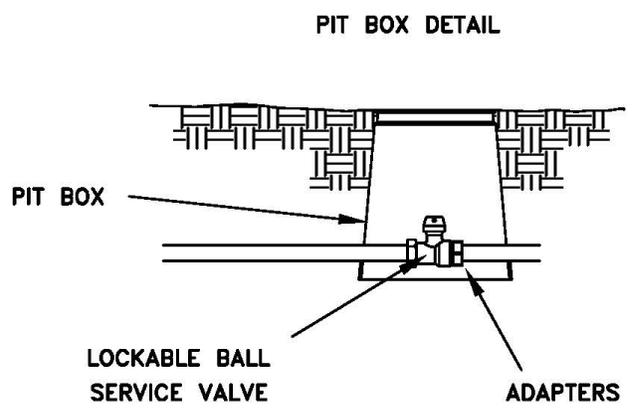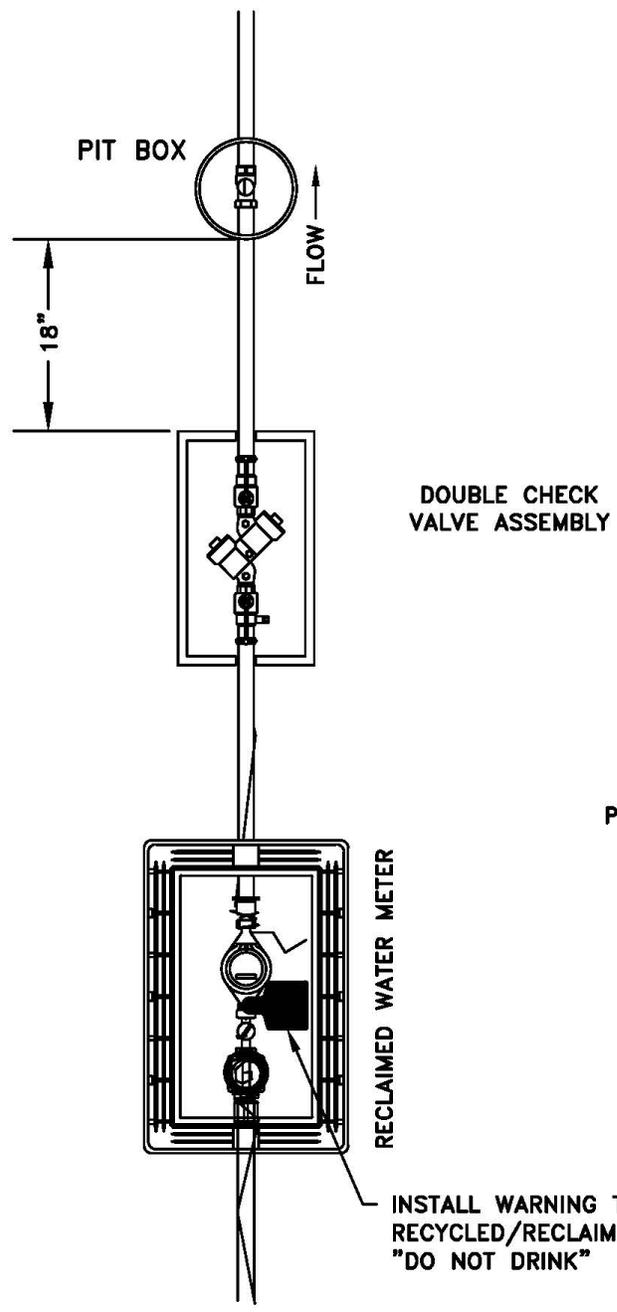

- GENERAL NOTES:**
1. THIS CONFIGURATION IS REQUIRED FOR IRRIGATION SYSTEMS THAT HAVE THEIR OWN WATER METER SUCH AS COMMERCIAL SITES.
 2. DO NOT INSTALL IN AREAS SUBJECT TO FLOODING.
 3. ALL PIPES, VALVE BOXES, METER BOXES AND LIDS SHALL BE PURPLE (PANTONE 512/522) IN COLOR.

DGB-4.7.DWG


CITY OF LACEY, WASHINGTON DEPT. OF PUBLIC WORKS			
IRRIGATION SERVICE FOR COMMERCIAL SITES TYPE II			
APPROVED <i>Rob A Schoenel</i> CITY ENGINEER			DWG. NO. 8-4.7
DES. WHO	DWN. WHO	CKD. RAS	DATE

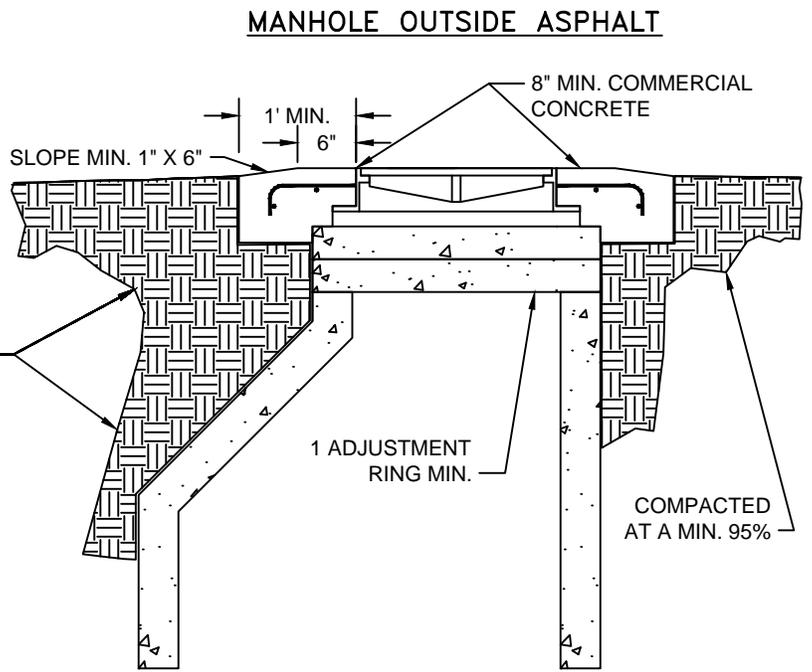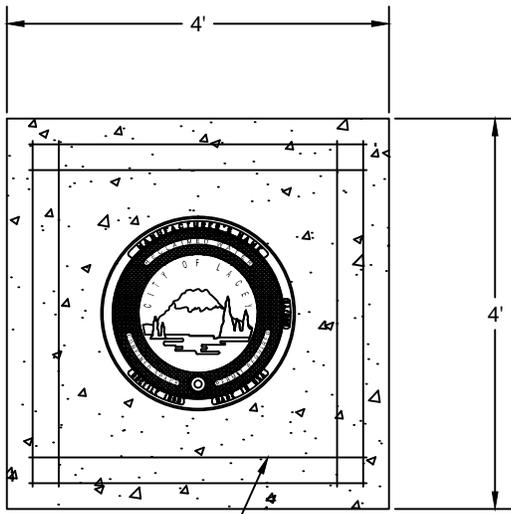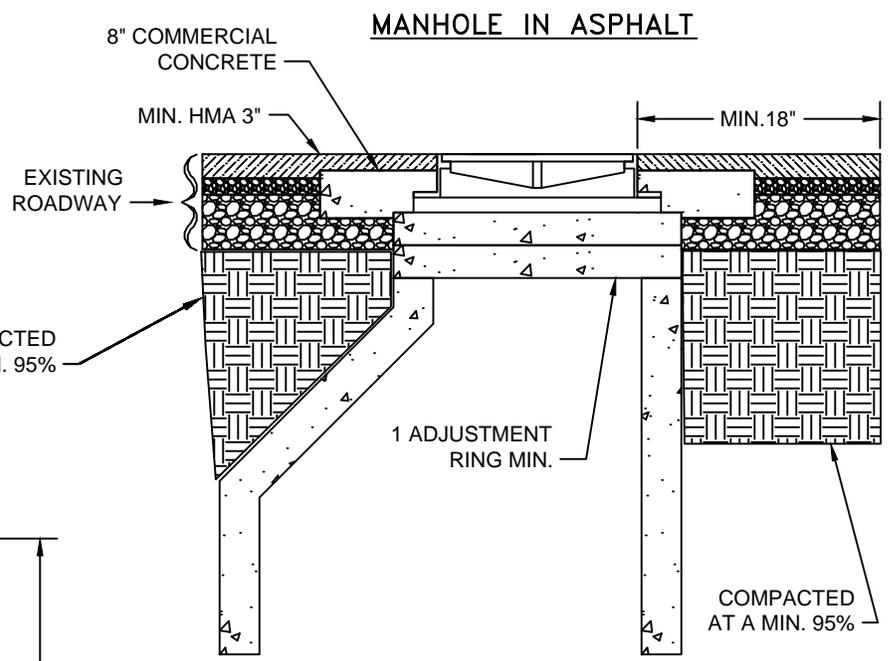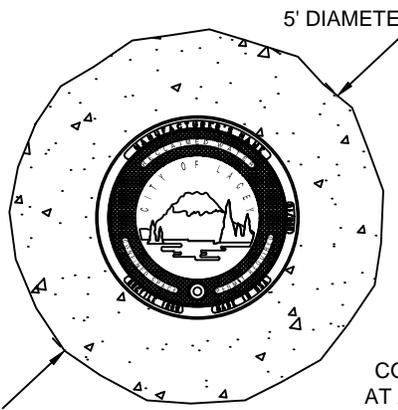

NTS

- GENERAL NOTES:**
1. ALL CONCRETE PADS FOR MANHOLES OUTSIDE THE ASPHALT SHALL HAVE REINFORCING STEEL AS SHOWN ABOVE, DEFORMED BAR TO MEET ASTM A615 GRADE 60 FY=60,000 P.S.I.
 2. ALL MANHOLE FRAME AND COVER ASSEMBLIES SHALL BE EJCO OR OLYMPIC FOUNDRY, WSDOT STYLE #41 WITH THE CITY LOGO STAMPED IN IT, DUCTILE IRON AND MANUFACTURED IN THE U.S.A.
 3. ADJUST GRADE RINGS WITH BRICK WEDGES OR GROUT. NO WOOD OR ROCKS SHALL BE USED AS ADJUSTMENT SPACERS.

CITY OF LACEY, WASHINGTON DEPT. OF PUBLIC WORKS			
RECLAIMED WATER MANHOLE LOGO COVER & FRAME INSTALLATION			
APPROVED <i>Rog A Schoenel</i> CITY ENGINEER		DWG. NO. 8-6	
DES WHO	DWN WHO	CKD RAS	DATE 12/15/2014

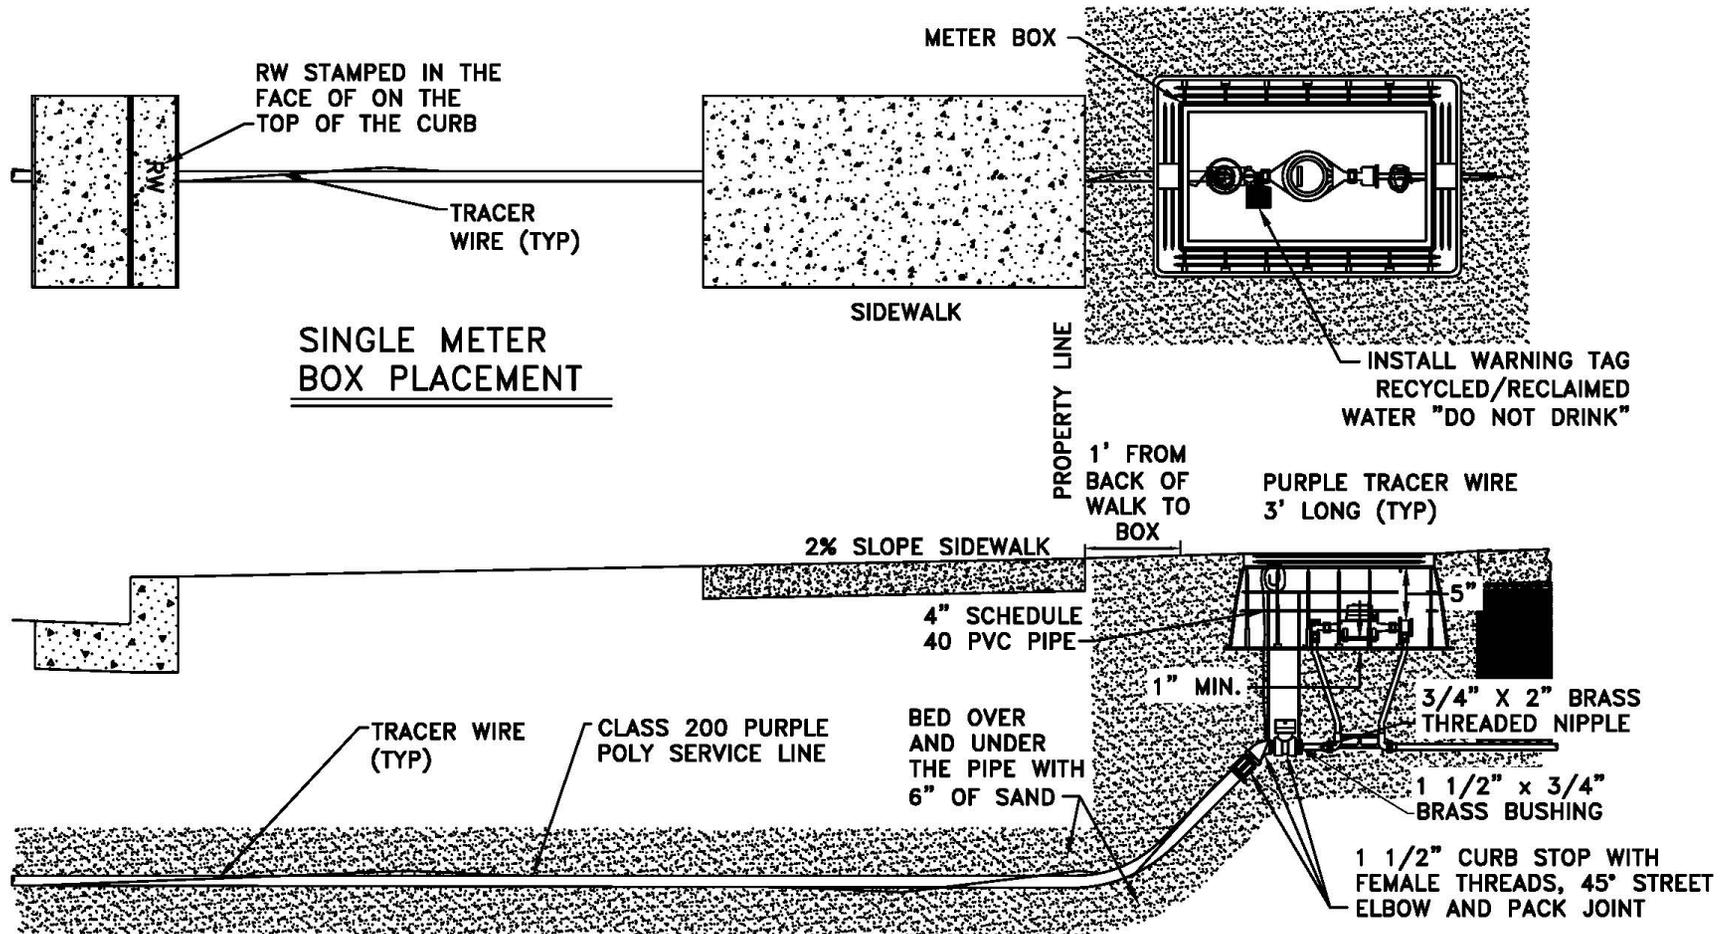

GENERAL NOTE:

1. RECLAIMED WATER METER BOX TO BE INSTALLED 1' BEHIND THE SIDEWALK IN THE JOINT UTILITY TRENCH EASEMENT.
2. BEDDING SHALL BE 6" UNDER AND 6" ABOVE THE PIPE.
3. SAND SHALL BE PLACED AT A MINIMUM 1' AROUND THE ENTIRE METER BOX OR BOXES FROM 6" ABOVE THE PIPE TO THE FINISH GRADE OF THE METER BOX.
4. EXTEND THE PIGTAIL 12' TO CLEAR THE JOINT UTILITY TRENCH.

**CITY OF LACEY, WASHINGTON
DEPT. OF PUBLIC WORKS**

**RECLAIMED WATER
METER INSTALLATION**

APPROVED

Bob A. Schaefer

CITY ENGINEER

DWG. NO.


8-7

DES
WHO

DWN
WHO

CKD
RAS

DATE
12/15/2014

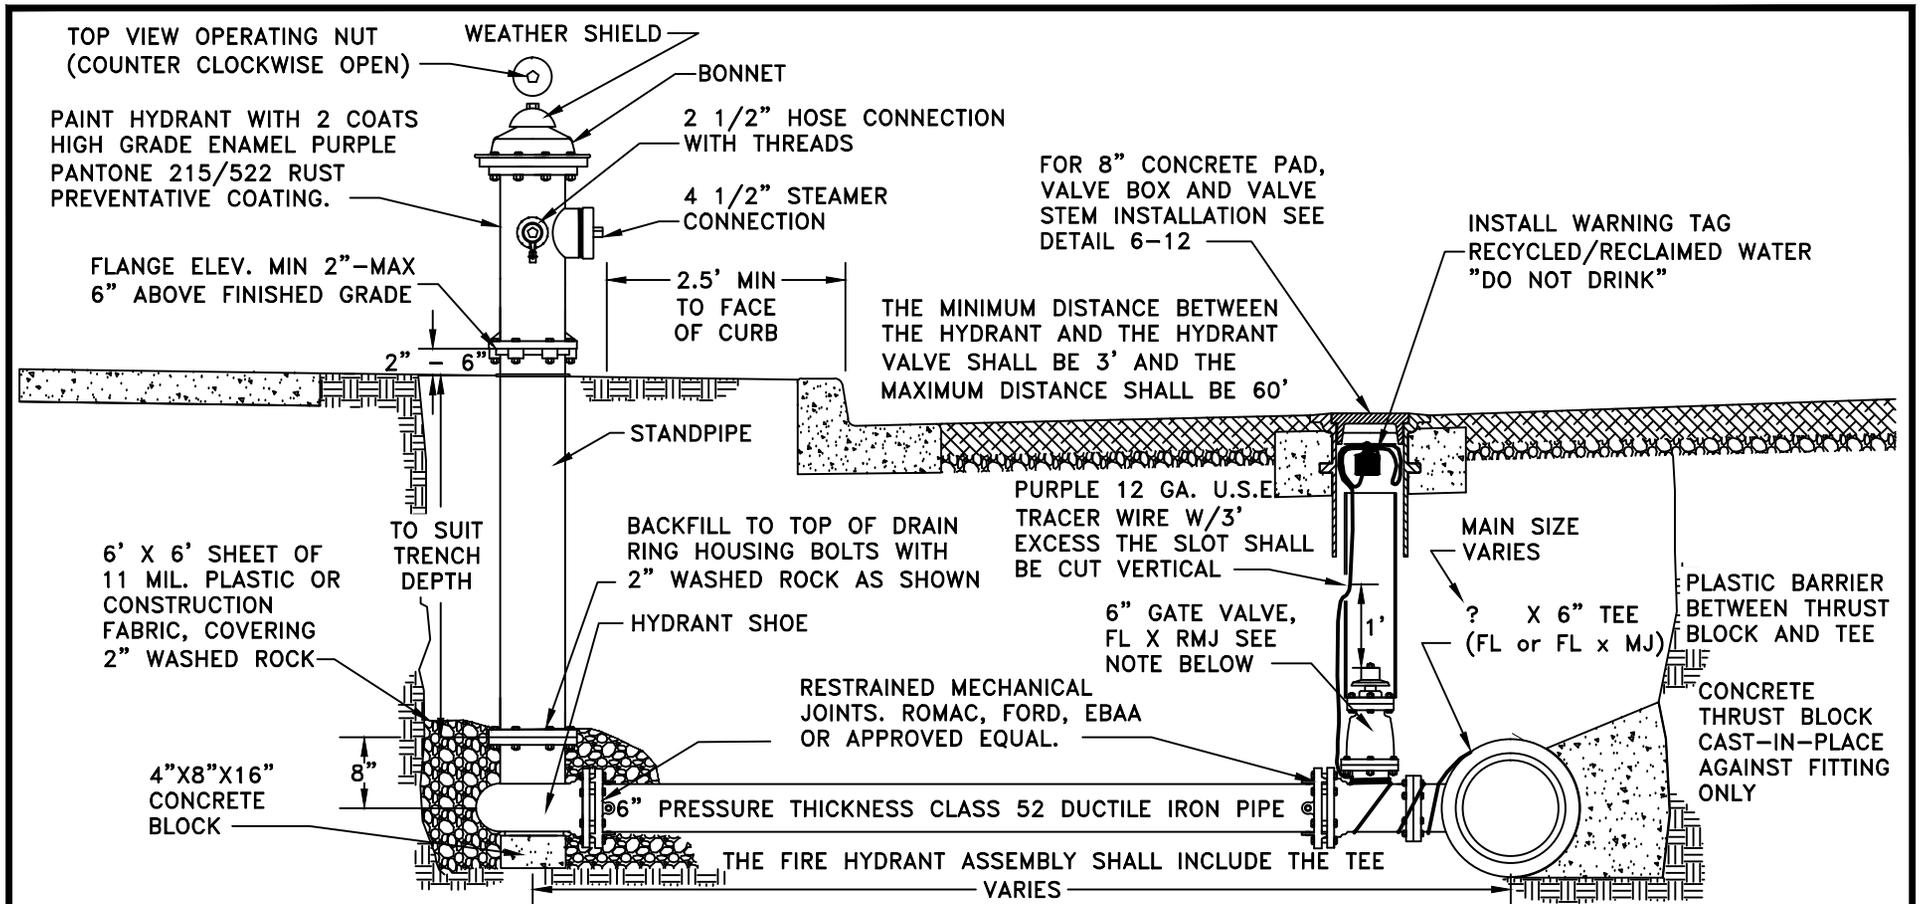

GENERAL NOTES:

1. A MINIMUM FIVE FOOT RADIUS OF UNOBSTRUCTED WORKING AREA SHALL BE PROVIDED AROUND ALL HYDRANTS. THE UNOBSTRUCTED AREA SHALL INCLUDE BUT NOT BE LIMITED TO TREES, SHRUBS, PLANTS, VAULTS, FDC AND METERS.
2. HYDRANT SHALL BE WATEROUS PACER, M & H RELIANT STYLE 929, AMERICAN AVK, KENNEDY K-81, MUELLER CENTURION AND EJIW 5CD250 WATER MASTER.
3. GATE VALVES SHALL BE RESILIENT WEDGE NRS WITH O-RING SEALS. VALVE ENDS SHALL BE MECHANICAL JOINT BY ANSI FLANGES. VALVES SHALL CONFORM TO AWWA C515. VALVES SHALL BE MUELLER, M&H, KENNEDY, CLOW R/W WATEROUS SERIES 500 OR EJIW FLOWMASTER.
4. REMOVE FACTORY CHAINS HOLDING CAPS.
5. WHEN DISTANCE BETWEEN HYDRANT AND VALVE EXCEED THE STANDARD LENGTH OF PIPE, FIELDLOK GASKETS OR MECHANICAL RESTRAINTS SHALL BE INSTALLED.

CITY OF LACEY, WASHINGTON
DEPT. OF PUBLIC WORKS

FIRE HYDRANT ASSEMBLY

APPROVED

Ray A. Schoenel
CITY ENGINEER

DWG. NO.

8-8

DES

WHO

DWN

WHO

CKD

RAS

DATE

12/15/2014


2 1/2" NST
OUTLET W/CAP

PAINT THE UNIT PURPLE
WITH 2 COATS OF HI
GRADE ENAMEL PANTONE
512 OR 522 PAINT

INSTALL WARNING TAG
RECYCLED/RECLAIMED WATER
"DO NOT DRINK"

CITY OF LACEY LOGO LID BY EAST
JORDAN IRON WORKS OR OLYMPIC
FOUNDRY DOT STYLE #MH-41. SEE
DWG 8-16 FOR MANHOLE COLLAR
INSTALLATION.

24" X 24" CONCRETE
STORM PIPE

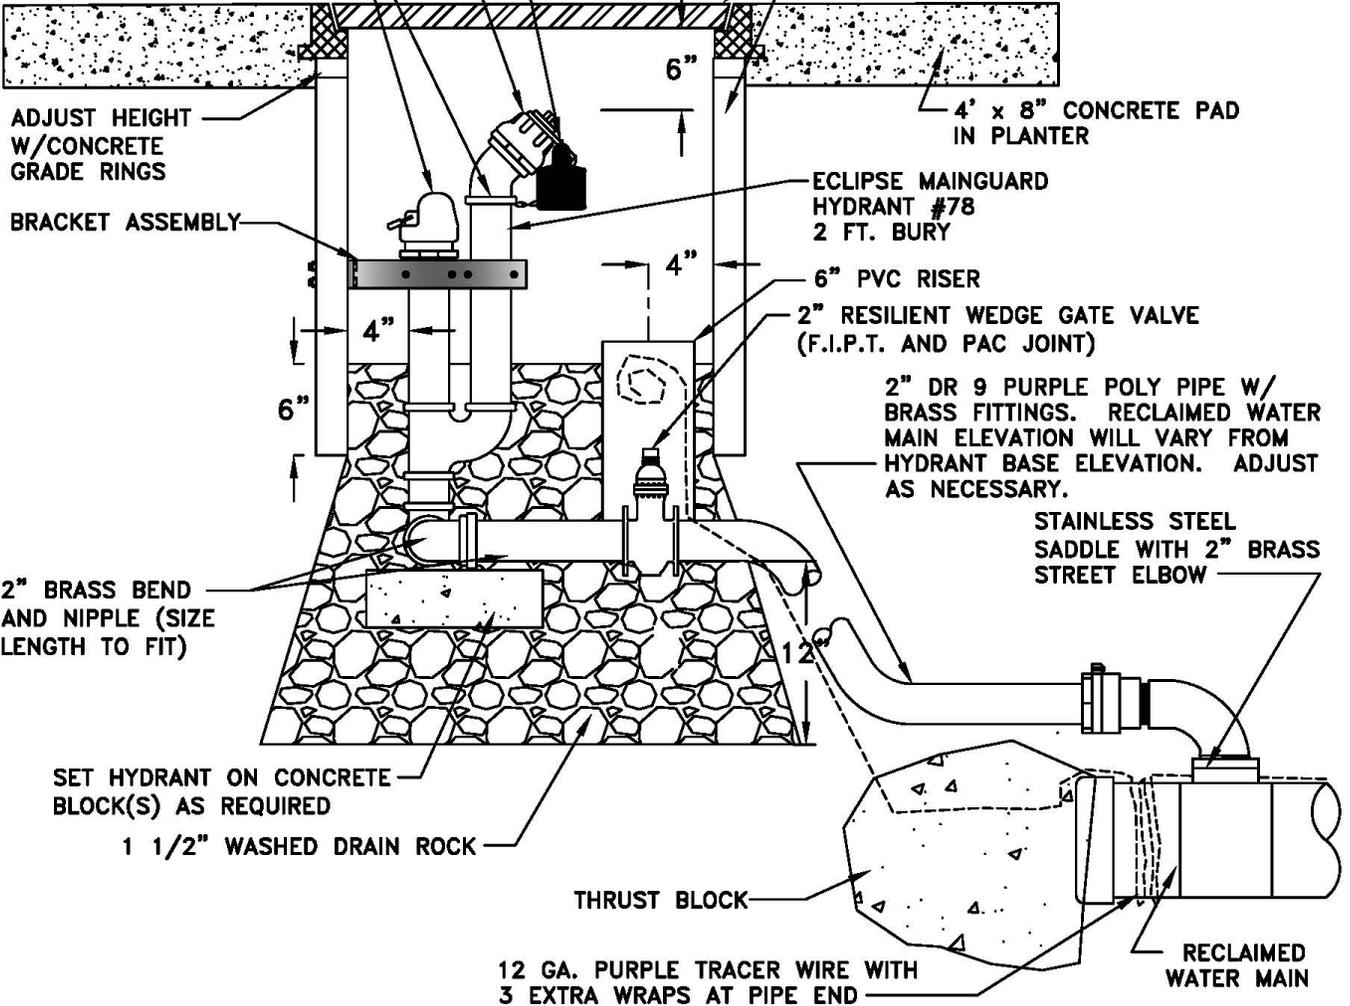

ADJUST HEIGHT
W/CONCRETE
GRADE RINGS

BRACKET ASSEMBLY

ECLIPSE MAINGUARD
HYDRANT #78
2 FT. BURY

6" PVC RISER

2" RESILIENT WEDGE GATE VALVE
(F.I.P.T. AND PAC JOINT)

2" DR 9 PURPLE POLY PIPE W/
BRASS FITTINGS. RECLAIMED WATER
MAIN ELEVATION WILL VARY FROM
HYDRANT BASE ELEVATION. ADJUST
AS NECESSARY.

STAINLESS STEEL
SADDLE WITH 2" BRASS
STREET ELBOW

2" BRASS BEND
AND NIPPLE (SIZE
LENGTH TO FIT)

SET HYDRANT ON CONCRETE
BLOCK(S) AS REQUIRED


1 1/2" WASHED DRAIN ROCK

THRUST BLOCK

12 GA. PURPLE TRACER WIRE WITH
3 EXTRA WRAPS AT PIPE END

RECLAIMED
WATER MAIN


BRACKET TOP VIEW

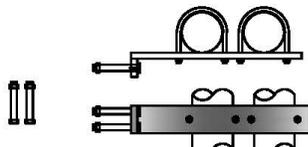

THE BRACKETS SHOULD BE CUSTOM MADE SINCE
THE SPACING OR LOCATION OF THE UNIT MAY
VARY. ALL PARTS SHALL BE STAINLESS STEEL A
MIN. 3/16" THICK, 1 3/4" HIGH. THE NUTS
AND BOLTS SHALL BE 3/8" STAINLESS STEEL.

CITY OF LACEY, WASHINGTON DEPT. OF PUBLIC WORKS			
BLOW-OFF HYDRANT ASSEMBLY IN THE PLANTER STRIP			
 CITY ENGINEER			DWG. NO. 8-10.1
DES. EP	DWN. BP	CKD. RAS	DATE 12/15/2014

LIVE TAP

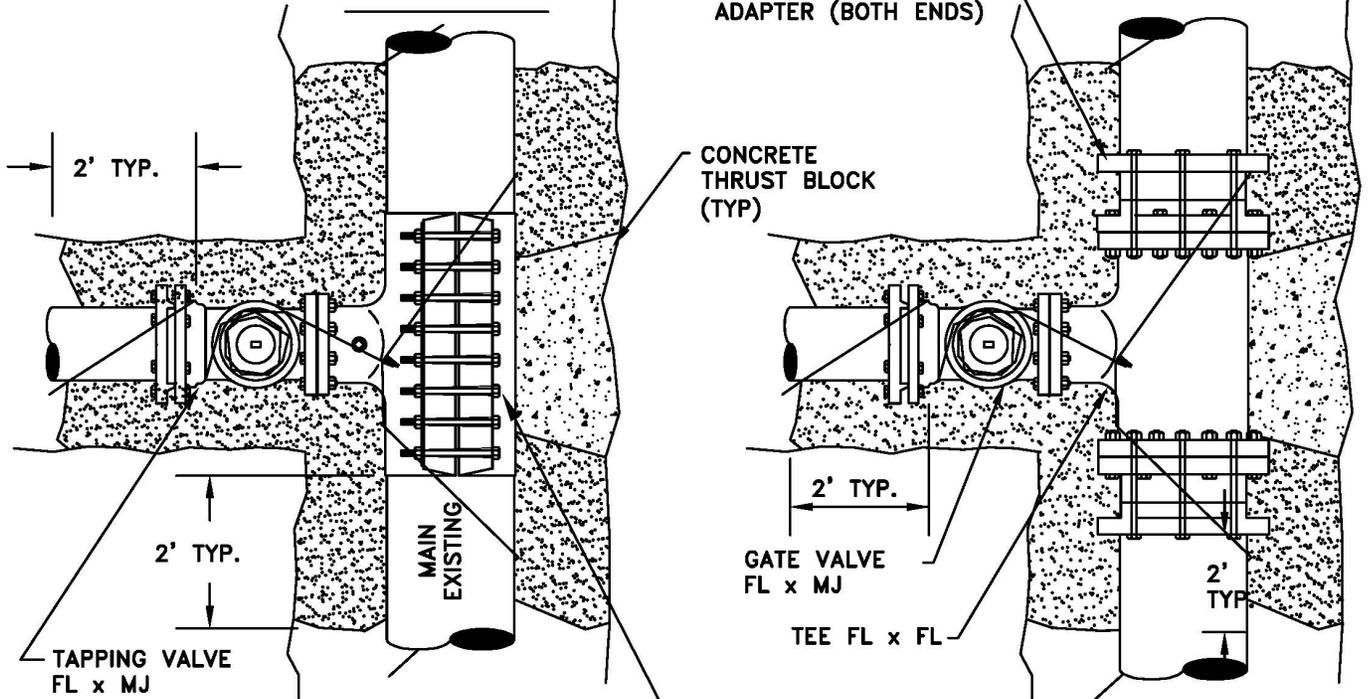

VALVE AND SLEEVE SHALL BE SUPPORTED AND BACKFILLED AS SHOWN BELOW-RIGHT.


ASTM APPROVED TAPPING SLEEVE (12" DIAMETER AND UNDER SHALL BE STAINLESS STEEL).

INSTALL WARNING TAG RECYCLED/RECLAIMED WATER "DO NOT DRINK"

PURPLE PANTONE 512 OR 522
12 GA. U.S.E. TRACER WIRE
W/3' EXCESS, THE SLOT
SHALL BE CUT VERTICAL

1/3 DIAMETER OF PIPE

CONTROLLED DENSITY BACKFILL
POURED WIDTH OF TRENCH, TWO FEET
PAST VALVE FLANGE UP TO 1/3
DIAMETER OF PIPE

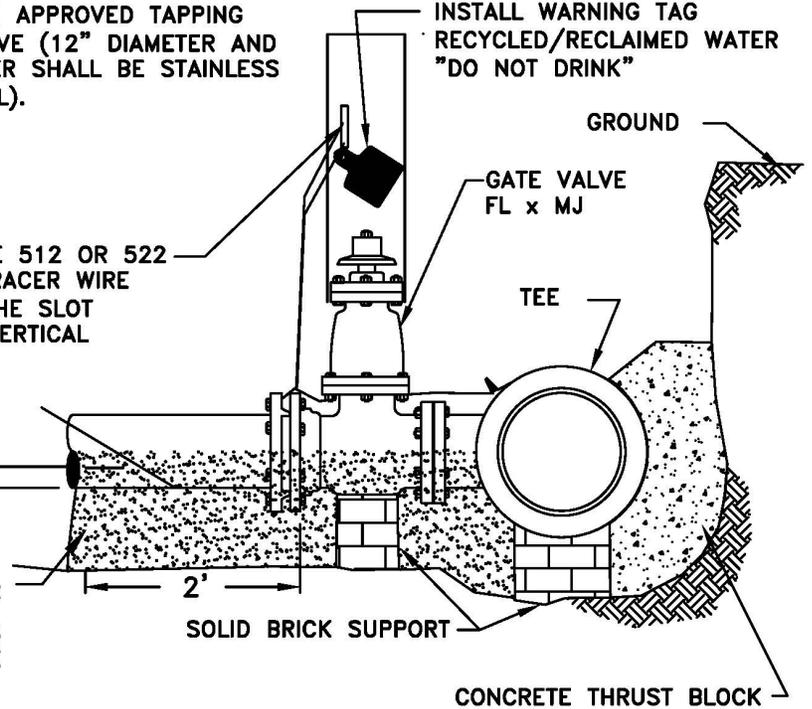

GENERAL NOTES:

- 11 MIL. PLASTIC OR CONSTRUCTION FABRIC SHALL BE WRAPPED AROUND PIPE AND FITTINGS BEFORE THRUST BLOCK OR CDF BACKFILL ARE POURED.
- CONTROLLED DENSITY FILL SHALL CONSIST OF 1750# SAND, 1750# PEA GRAVEL, 230# WATER, 141# CEMENT, 6 OUNCES WATER REDUCING AGENT PER 100# CEMENT.
- MJ CUT IN TEES SHALL NOT BE PERMITTED.
- THE EXISTING MAIN, TAPPING SLEEVE AND VALVE SHALL BE SUPPORTED THROUGHOUT THE ENTIRE PROCESS WHEN TAPPING THE EXISTING RECLAIMED WATER MAIN.


CITY OF LACEY, WASHINGTON
DEPT. OF PUBLIC WORKS

CONNECTION TO
EXISTING MAIN

APPROVED
Reg A Schoenel
CITY ENGINEER

DWG. NO.
8-11

DES. LRW	DWN. WHO	CKD. RAS	DATE 12/15/2014
-------------	-------------	-------------	--------------------

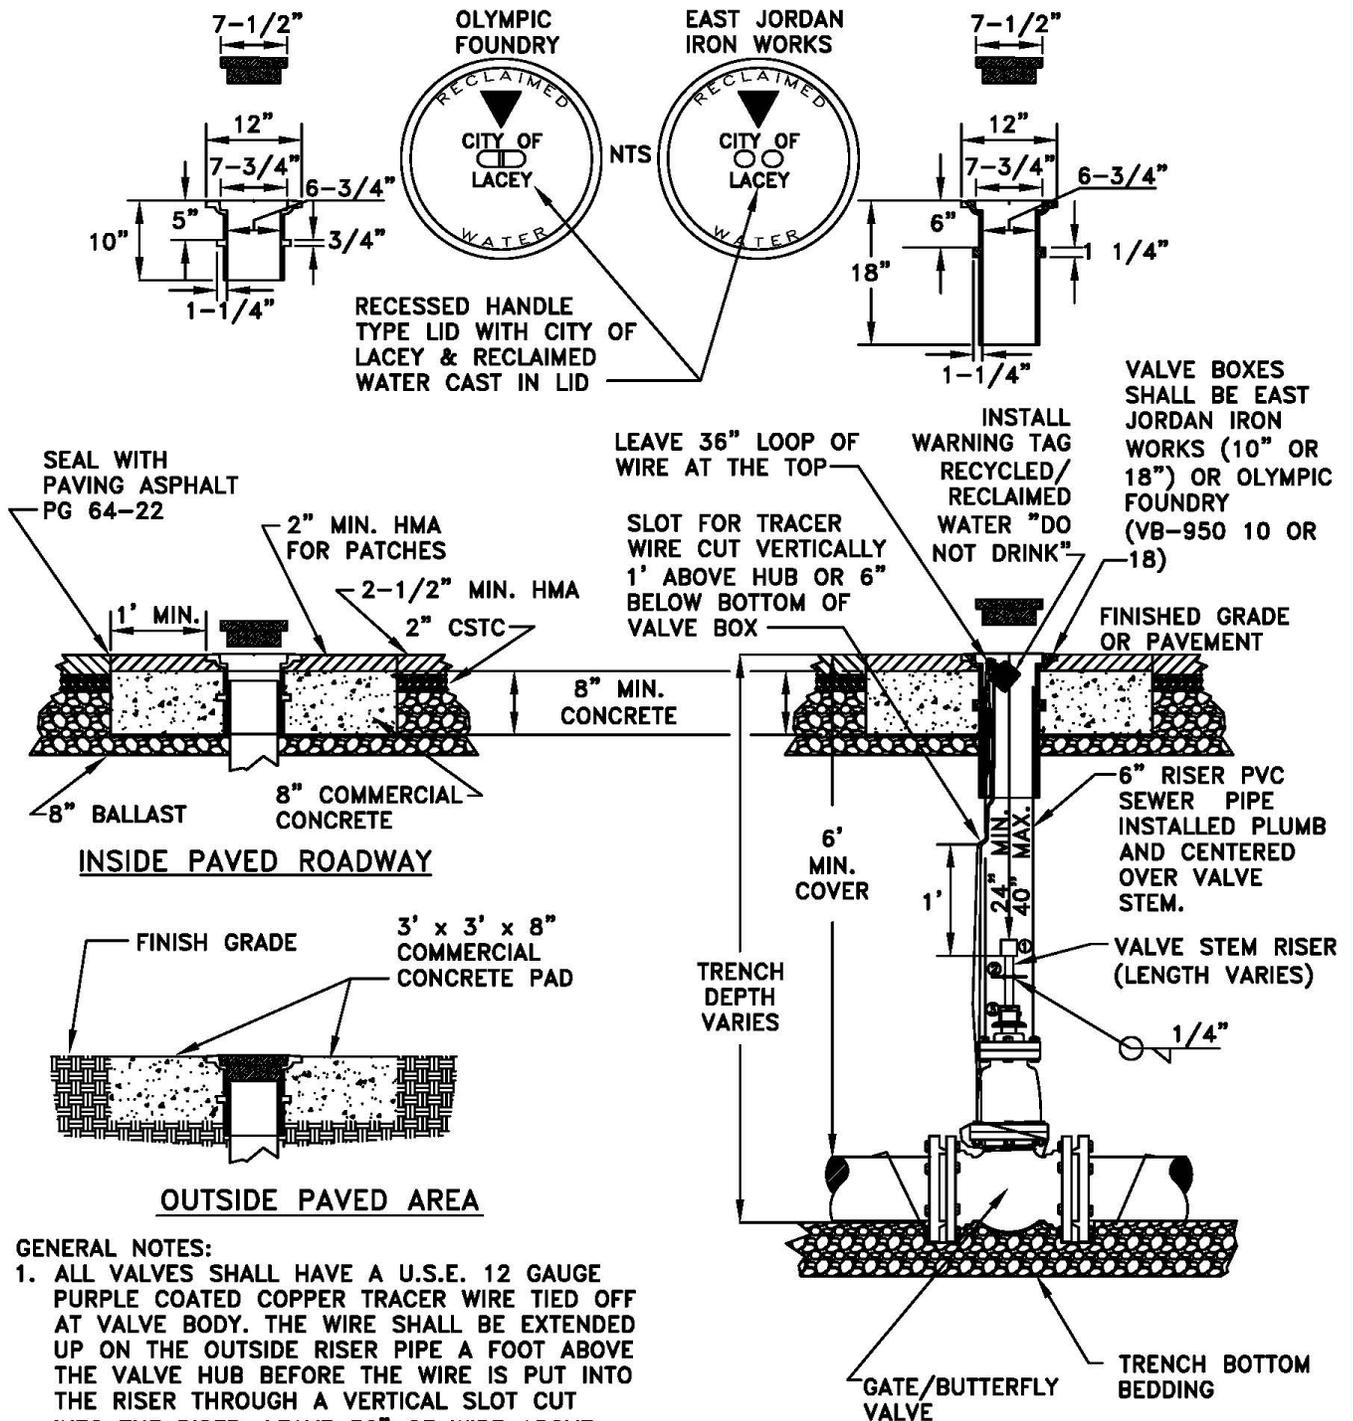


GENERAL NOTES:

1. ALL VALVES SHALL HAVE A U.S.E. 12 GAUGE PURPLE COATED COPPER TRACER WIRE TIED OFF AT VALVE BODY. THE WIRE SHALL BE EXTENDED UP ON THE OUTSIDE RISER PIPE A FOOT ABOVE THE VALVE HUB BEFORE THE WIRE IS PUT INTO THE RISER THROUGH A VERTICAL SLOT CUT INTO THE RISER. LEAVE 36" OF WIRE ABOVE THE TOP OF VALVE BOX.
2. ALL WELDS TO THE SHAFT SHALL BE FILLET WELD, AROUND THE ENTIRE PLATE PER #2 BELOW,

VALVE STEM EXTENSION LEGEND

- ① VALVE OPERATING NUT OR 1-7/8" X 1-7/8" X 2" HIGH GRADE STEEL WELDED TO GUIDE PLATE.
- ② 3/16" THICK X 5 1/5" DIA STEEL GUIDE PLATE WELDED TO RISER SHAFT.
- ③ 2"x2"x 3/16" SQUARE STRUCTURAL STEEL TUBING TO FIT OPERATING NUT. LENGTH AS REQUIRED.

CITY OF LACEY, WASHINGTON DEPT. OF PUBLIC WORKS			
STANDARD VALVE BOX INSTALLATION			
APPROVED <i>Rog A Schoessel</i> CITY ENGINEER		DWG. NO. 8-12	
DES WHO	DWN WHO	CKD RAS	DATE 12/15/2014

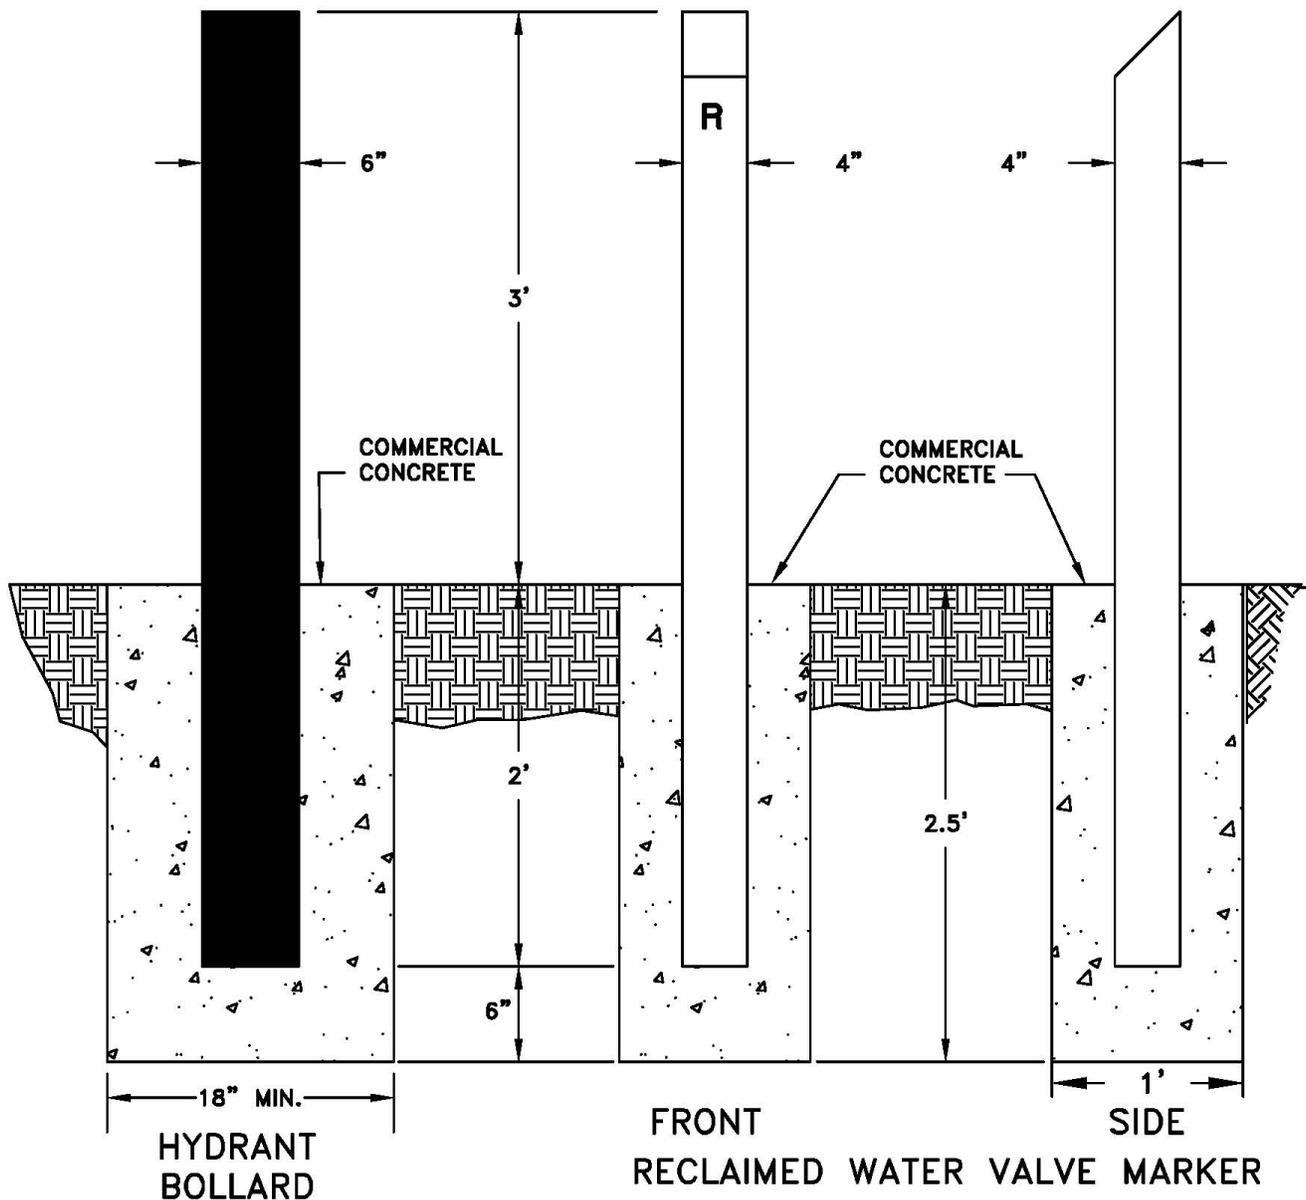

GENERAL NOTES:

1. HYDRANT BOLLARDS SHALL BE INSTALLED AT A MINIMUM OF 5' FROM THE HYDRANT SITUATED SO AS NOT TO BLOCK ANY OF THE HYDRANT PORTS.
2. THE HYDRANT BOLLARDS SHALL BE 6" IN DIAMETER SCHEDULE 20 STEEL POST AND FILLED WITH CONCRETE.
3. THE HYDRANT BOLLARDS SHALL BE COATED WITH 1 PRIME COAT AND TWO COATS OF PANTONE 512 OR 522 OUTDOOR OIL BASE ENAMEL.
4. WHEN HYDRANT BOLLARDS ARE REQUIRED IN HIGH TRAFFIC AREAS GLASS BEADS SHALL BE SPRAYED OR PLACED ON THE WET PAINT TO PROVIDE BETTER VISABILITY AT NIGHT.

GENERAL NOTES:

1. 4" SCHEDULE 40 STEEL OR REINFORCED CONCRETE MARKER POST STAMPED WITH "RW" AND DISTANCE TO VALVE.
2. THE POST TO BE COATED WITH ONE PRIME COAT AND TWO COATS OF PANTONE 512 OR 522 OUTDOOR OIL BASE ENAMEL.

**CITY OF LACEY, WASHINGTON
DEPT. OF PUBLIC WORKS**

**HYDRANT BOLLARD &
VALVE MARKER POST
DETAIL**

APPROVED

Reg A Schoessel
CITY ENGINEER

DWG. NO.

8-13

DES

WHO

DWN

WHO

CKD


RAS

DATE

12/15/2014

KORALEEN
0001-3 STATION GUARD XLT
WATER QUALITY SAMPLING STATION

TYPICAL INSTALLATION

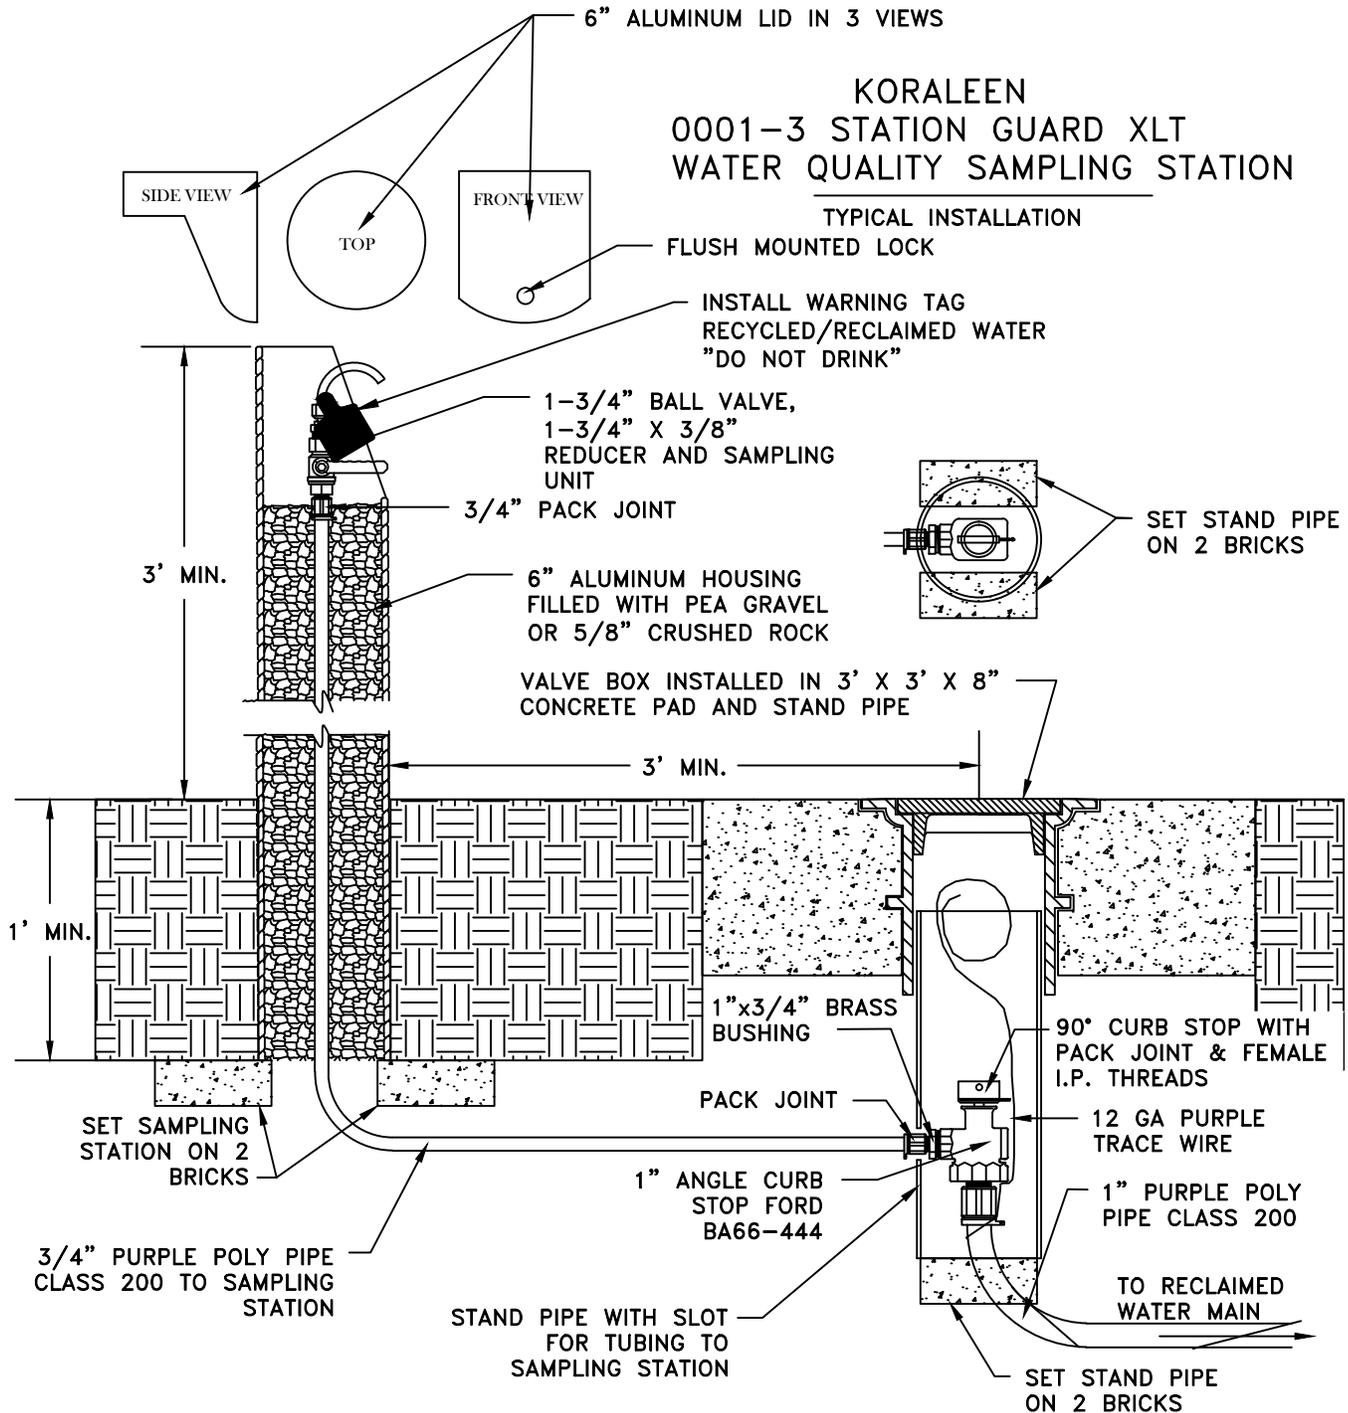


GENERAL NOTES:


1. THE KORALEEN SAMPLING STATION SHALL BE INSTALLED BEHIND THE SIDEWALK WITHIN 1 FOOT OF THE PROPERTY LINE AND WHEN POSSIBLE IN A OPEN SPACE. THE VALVE BOX SHALL BE INSTALLED IN THE PLANTER STRIP IN A CONCRETE PAD.
2. THE STAND PIPE SHALL REST ON A BRICK TO PROTECT THE WATER LINE FROM BEING CRUSHED.
3. A TRACER WIRE SHALL BE INSTALLED WITH THE WATER LINE.
4. THE HOUSING SHALL BE POWDER COATED WITH 2 COATS OF HI GRADE ENAMEL PURPLE

512/522 PAINT.
DGB-17.DWG

CITY OF LACEY, WASHINGTON
DEPT. OF PUBLIC WORKS

KORALEEN SAMPLING
STATION

 CITY ENGINEER			DWG. NO. 8-17
DES. WHO	DWN. WHO	CKD. RAS	DATE 12/15/2014

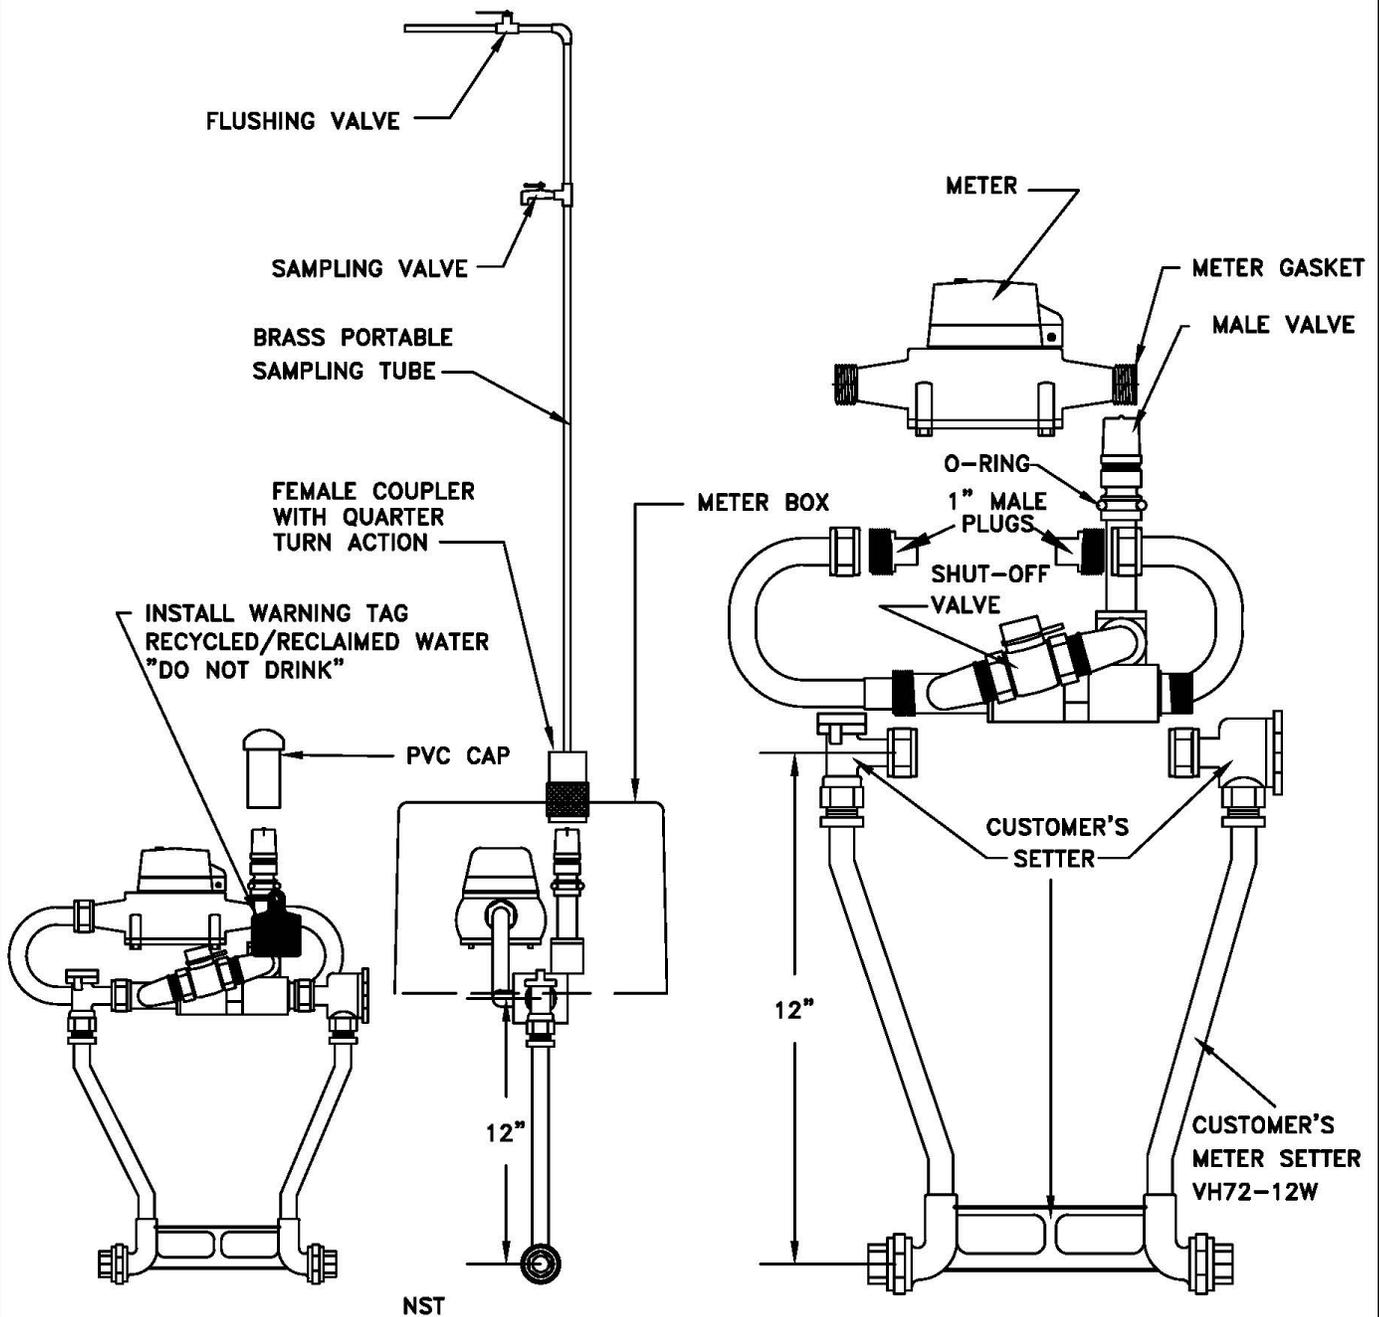


GENERAL NOTES:

1. PROVIDE THE CITY WITH A BRASS PORTABLE SAMPLING TUBE.
2. PROVIDE 2 EACH 1" MALE PLUGS TO CAP AND PROTECT THE SAMPLING UNIT.
3. THE SAMPLING STATION SHALL BE A SINGLE METER SET-UP. INSTALLED 1' BEHIND THE SIDEWALK WITH A PURPLE METER BOX AND LID WITH CITY OF LACEY STAMPED IN THE LID.

DG8-18.DWG

CITY OF LACEY, WASHINGTON DEPT. OF PUBLIC WORKS			
#93-WM SAMPLING STATION FOR RECLAIMED WATER			
<i>Roger A. Schaeffer</i> CITY ENGINEER			DWG. NO. 8-18
DES.	DWN.	CKD.	DATE
WHO	WHO	RAS	

DGB-23.DWG

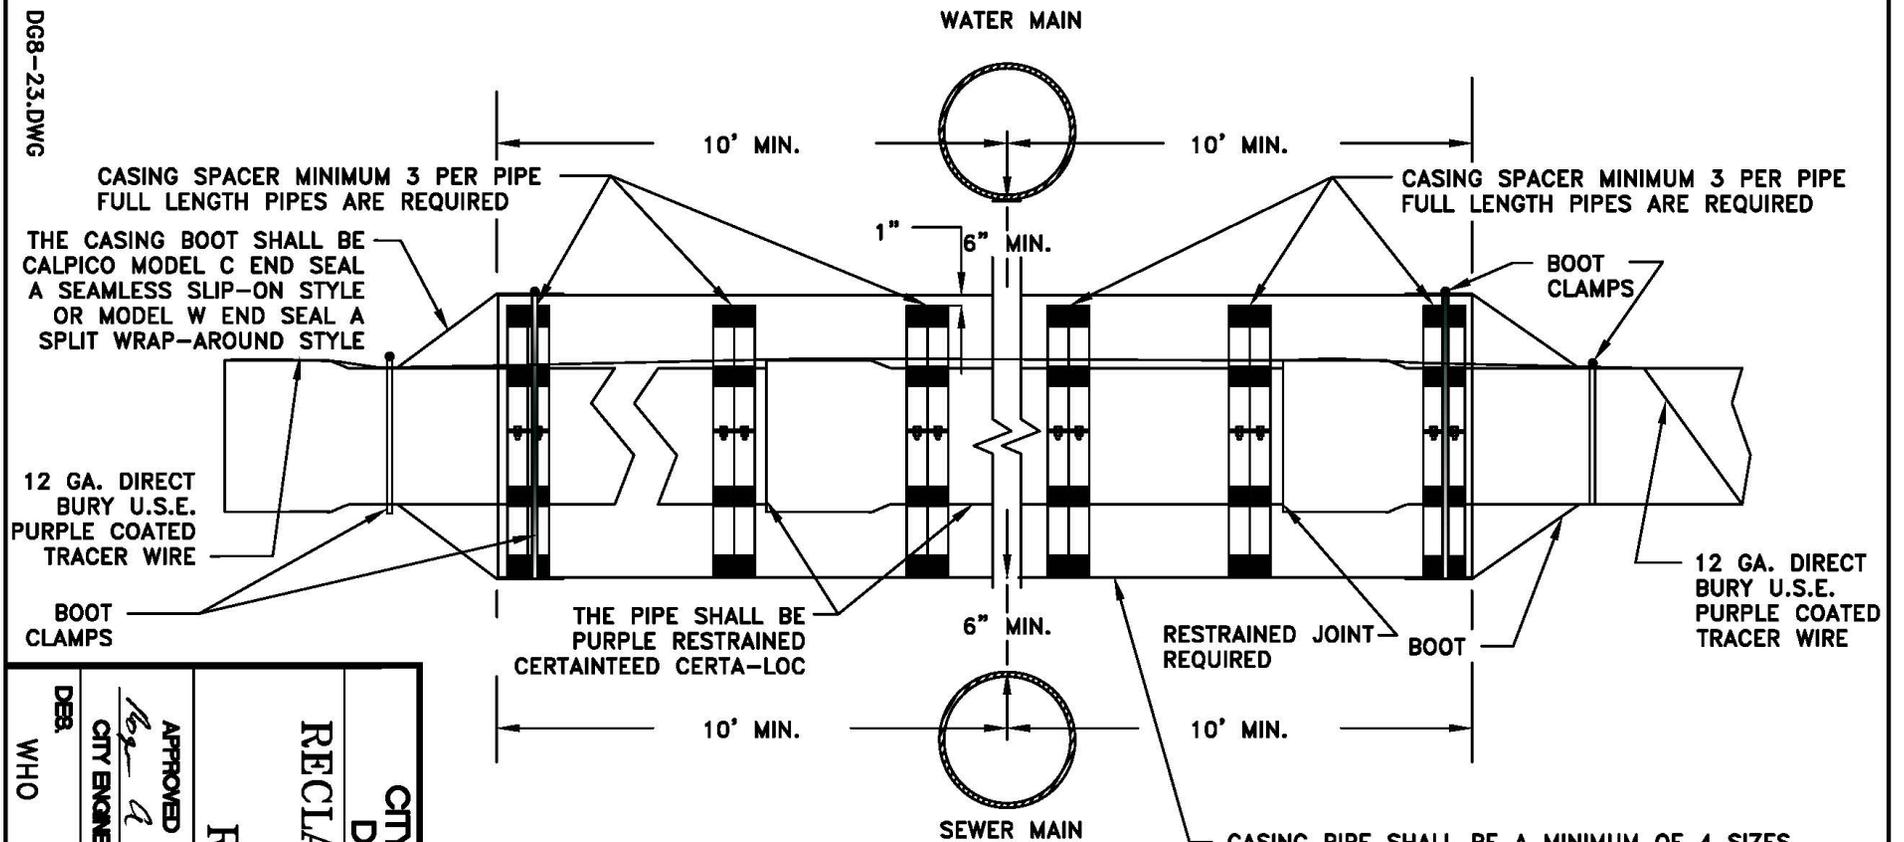


CITY ENGINEER		APPROVED	
WHO	WHO	WHO	WHO
DEB	DWN	CKD	DATE
8-23			
CITY OF LACEY, WASHINGTON DEPT. OF PUBLIC WORKS RECLAIMED WATER PIPE ENCASEMENT REQUIREMENTS			

GENERAL NOTES:

1. MANUFACTURED CASING SPACERS ARE REQUIRED AND SHALL BE UNI-FLANGE OR CALPICO INC. PRODUCTS OR AS APPROVED BY THE CITY OF LACEY.
2. THE PIPE LENGTHS SHALL BE 20' WITH A MINIMUM OF 3 CASING SPACERS PER PIPE.
3. THERE SHALL BE NO MORE THAN 1" OF CLEARANCE BETWEEN THE TOP OF THE SPACER TO THE TOP OF THE CASING.
4. ALL JOINTS FOR THE PIPE BEING INSTALLED SHALL BE RESTRAINED.
5. SINCE PLASTIC PIPE IS REQUIRED BY THE CITY THE RESTRAINTS SHALL BE APPROVED BEFORE IT CAN BE ORDERED.
6. SINCE MOST CASING SPACERS ARE MANUFACTURED WHEN ORDERED ALL OF THE ABOVE INFORMATION SHOULD BE OBTAINED AS EARLY AS POSSIBLE SO THERE IS NO DELAY IN THE PROJECT.

EMULSIFIED ASPHALT GRADE
 CSS-1 TACK SHALL BE APPLIED
 TO EDGES OF EXISTING PAVEMENT.
 ALL JOINTS SHALL BE SEALED
 USING PAVING ASPHALT PG 64-22

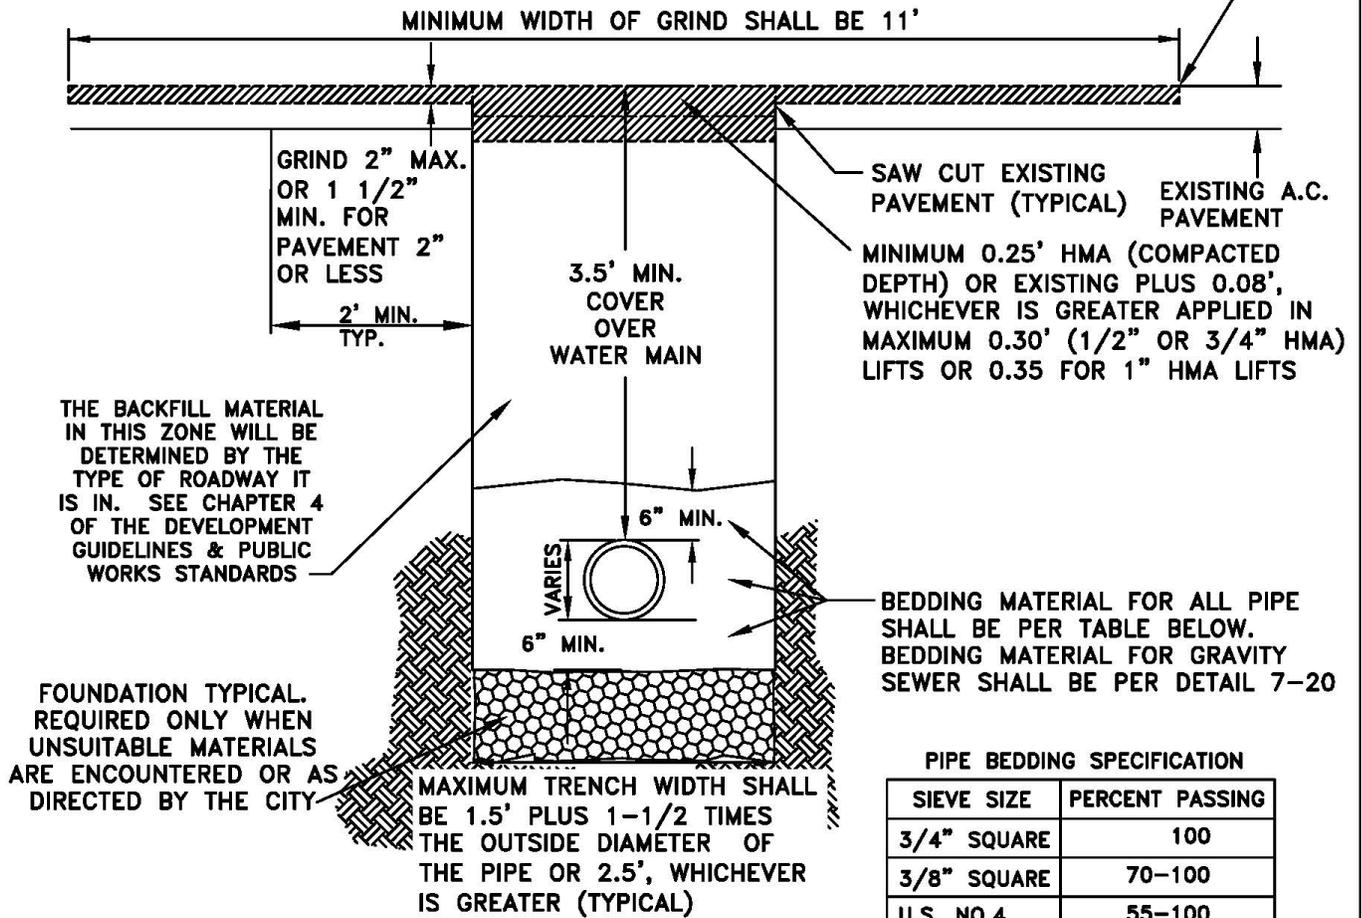

PIPE BEDDING SPECIFICATION

SIEVE SIZE	PERCENT PASSING
3/4" SQUARE	100
3/8" SQUARE	70-100
U.S. NO.4	55-100
U.S. NO. 10	35-95
U.S. NO. 20	20-80
U.S. NO. 40	10-55
U.S. NO. 100	0-10
U.S. NO. 200	0-03

GENERAL NOTES:

1. ALL MATERIALS EXCEPT H.M.A. SHALL BE COMPACTED IN 6-INCH MAXIMUM LIFTS TO 95% DENSITY AS DETERMINED BY ASTM D1557.
2. ALL MATERIALS, WORKMANSHIP, AND INSTALLATION SHALL BE IN CONFORMANCE WITH THE WSDOT STANDARD SPECIFICATIONS FOR ROAD, BRIDGE AND MUNICIPAL CONSTRUCTION AS AMENDED BY CITY OF LACEY STANDARDS.
3. KEEP TRENCH BOTTOM COMPACTED WITH UNIFORM GRADE. NO TEMPORARY SUPPORTS, I.E. BLOCKS, WILL BE ALLOWED TO SUPPORT PIPE. TRENCH BOTTOM SHALL BE TO GRADE PRIOR TO PIPE INSTALLATION.
4. WHENEVER GROUND WATER IS PRESENT A BARRIER SHALL BE INSTALLED ABOVE THE BEDDING.

CITY OF LACEY, WASHINGTON
 DEPT. OF PUBLIC WORKS

PIPE ZONE BEDDING FOR
 RECLAIMED WATER MAINS &
 SERVICES

APPROVED

Rog A Schoessel
 CITY ENGINEER

DWG. NO.

8-26

DES

WHO

DWN

WHO

CKD

RAS

DATE

12/15/2014